General Information

Introduction F-COMB-2

Combination Assembly Recommendations and Limitations

Design Considerations and Examples F-COMB-3
Single-Unit Opening Recommendations F-COMB-6
Typical Sealant Recommendations F-COMB-6
Two-Way Joint Recommendations
Horizontal Window Combinations F-COMB-7
Vertical Window Combinations F-COMB-8
Three-Way Joint Recommendations F-COMB-9
Four-Way Joint Recommendations F-COMB-10
Door to Door and Window to Door Recommendations F-COMB-11
Vertical Window Mullion Component Parts and End Anchors F-COMB-12
Horizontal Window Mullion Component Parts and End Anchors F-COMB-13
Vertical Door Mullion Component Parts and End Anchors F-COMB-14
Horizontal Door Mullion Component Parts and End Anchors F-COMB-15
Combination End Anchor Capacities F-COMB-16
Typical Combinations - Sample Calculations F-COMB-17
Mullion Load Charts
Two-Way Mullion of any Combination of Rectangle Windows F-COMB-20
Three-Way Mullion of any Combination of Rectangle Windows F-COMB-22
Four-Way Mullion of any combination of Rectangle Windows F-COMB-24
Two-Way Mullion of Rectangle Window to Special Shape F-COMB-26
Three-Way Mullion of 2 Rectangle Windows to Special Shape F-COMB-28
Two-Way Mullion, Vertical Door to Door F-COMB-30
Two-Way Mullion, Horizontal Door to Rectangle Transom F-COMB-31
Two-Way Mullion, Horizontal Door to Shape Transom F-COMB-33
Three-Way Mullion, Door to Two Transoms, Horizontal Structure F-COMB-34
Four-Way Mullion, Two Doors to Two Transoms Horizontal Structure F-COMB-36
Four-Way Mullion, Two Doors Mulled to Two Transoms Vertical Structure F-COMB-38

Supporting documents for this product:

CAD cross sections (requires appropriate CAD software to read and use):

Door Reinforcing Mullions

https://media.pella.com/professional/adm/Fiberglass/F2DrComboMul_D.dwg

https://media.pella.com/professional/adm/Fiberglass/F2DrComboMul_D.dxf

Window Reinforcing Mullions

https://media.pella.com/professional/adm/Fiberglass/F2WdwComboMul_D.dwg

https://media.pella.com/professional/adm/Fiberglass/F2WdwComboMul_D.dxf

Introduction and Definitions

This section explores the opportunities, requirements and limitations related to joining various combinations of standard Pella® Impervia® windows and doors.

Important:

Determining and meeting the structural load requirements and design of the rough opening is the responsibility of the architect or engineer. Window and door frame systems are not designed to support additional elements or components of the building wall system.

Specific accessories and construction details must address the various conditions that are critical for the proper design of a horizontal combination of windows (ribbon windows) and vertical combination (stacked windows) such as:

- Proper flashing
- Control joints to accommodate expansion and contraction
- Intermediate structural support
- Mullion reinforcing end anchorage
- Rough opening wall construction to accept loads transferred from window combination.

Definitions:	
Combination	An assembly formed by two or more separate windows, window composites, or doors whose frames are mulled together using a combination joining mullion or reinforcing mullion.
Standard Joining Mullion (Tight Mullion)	A mulling method formed by joining two or more individual window or door units together without a mullion stiffener.
Structural Mullion (Aluminum Mullion)	A mulling method formed by joining two or more individual window or door units together with an added continuous aluminum mullion stiffener.
Structural Mullion with Reinforcement (Aluminum Mullion)	A mulling method with an added continuous aluminum mullion stiffener including a continuous steel plate reinforcement insert.
Composite	A window or door consisting of two or more sash in one frame utilizing an integral mullion. See individual product sections for min/max and composite square ft validation.
Integral Mullion	A horizontal or vertical member which is bounded at either end or both ends by a crossing frame member.

The following steps are provided as a guide to help the designer properly integrate Pella products and accessories in combination assemblies. Sample calculations based on these steps are included later in this document.

1. **Determine the overall size and configuration of the combination.**

   The following page shows the basic combination assembly types. Windows or doors within the combination can be fixed or venting.

2. **Determine the required wind load (design pressure).**

   The design pressure is the wind load pressure that the window assembly is to withstand. The design pressure should be determined by the project engineer or architect but can also be provided by the local code official.

   ASCE 7, Minimum Design Loads for Buildings and Other Structures, contains the generally accepted method for determining design pressure for components and cladding based on building size and shape, geographical location, topographical factors, building use and location on the building's surface.

3. **Determine if the individual windows and/or doors within the assembly meet the required design pressure.**

   Each Pella window and door is rated to withstand a certain level of wind loading. The design pressure determined in step 2 should also be used to specify window and door performance. The Performance section of this manual provides more detailed information on the relationship between design pressure and the performance class and grade ratings used to specify window/door performance. See each product section in this manual to determine if each window or door can withstand the required design pressure.

4. **Determine if the glazing within each product can withstand the required design pressure.**

   ASTM E 1300-16 requires that glazing be of adequate strength to resist excessive deflection under wind load. Select the appropriate glazing type and/or thickness required to meet the design pressure. Your local Pella sales representatives can utilize the Pella quoting system to assist in determining the glazing design pressure of a specific product.

5. **Determine if the combination will be factory assembled or non-factory assembled.**

   Use the combination size tables and Factory Assembled Window Combination Configuration Rules found in this section to determine if the combination is available factory assembled. If it is not found in the size tables, it is not available from the factory. Also consider factors such as installation method, handling and accessibility to the opening. Conditions specific to the project may require that a combination be assembled at the job-site or in the opening.

6. **Determine the requirement for spread or reinforcing mullions.**

   Placing windows and doors in an assembly creates joints or mullions that may need reinforcing and/or flashing requirements. In order to ensure that a given combination will withstand the design pressure determined in step 2, use the mullion joint load tables starting on page 17. These tables are organized by joint type. Use the graphical representation of each joint type to determine which joint type(s) are contained within the combination. The reinforcing tables consider structural performance only. Performance class and grade ratings apply to single units only. See the Size and Performance Data page within each product section for more information.

   Also consider the dead load when placing window mullions over the clear opening space of vent windows or doors.

7. **Determine the appropriate reinforcing mullion.**

   The mullion reinforcing tables in this section are intended to aid in the selection of reinforcing members to help the assembly resist the forces placed upon it by wind loads and loads caused by other units within the combination. Page 14 provides instruction on how to use the tables. By entering the tables with the joint's mullion length and the widths of the adjacent units, choose any mullion reinforcing option at or below the coordinate given on the table. If spread mullions are desired for aesthetic reasons, use the tables to determine if the spread mullion is sufficient.

8. **Determine actual rough opening size and window/door data.**

   This section contains recommendation pages for each assembly type. Use the recommendations in this section to determine rough opening clearance dimensions as well as if subsill is required. Add any applicable frame, accessory, and mullion dimensions to arrive at the overall opening dimensions.

   The combination assembly design example later in this document shows how these steps can be followed to design a combination assembly.

Impervia Factory Assembled Window Combination Configuration Rules

1. Factory Assembled Combination width and height maximum is 143.5" x 105.5" (block frame no fin) and 138.5" x 101" (block frame with standard and offset fin) with a total of 80 square feet and 500 lbs. maximum.
2. These combinations not allowed.

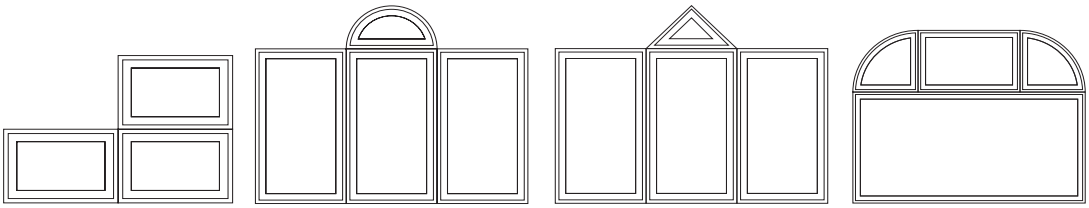

3. All mullions must pass through mullion validation rules.
4. If the combination has more than 2 units, base frame depth cannot vary within a row and column (see diagram below).
5. DH's may not be mulled over other units using an aluminum mullion
6. All slopes (curved or straight) must continue to the end(s) of the combination.
7. Integral fin units can not be mulled.
8. Field spread mulled combinations OR combinations configured for alignment purposes may not be restricted by these rules.

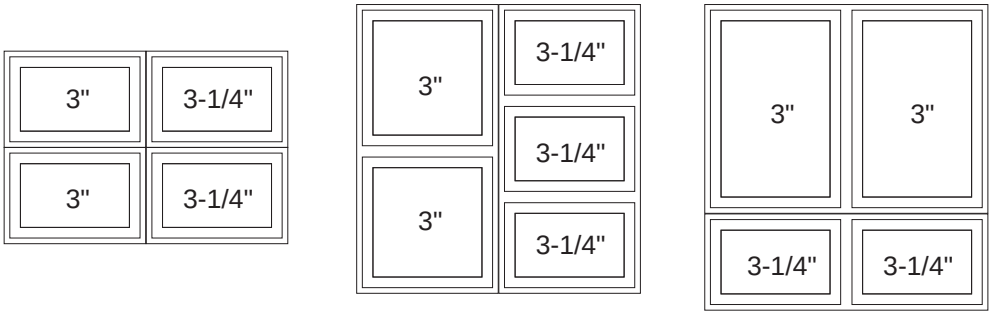

Composite Configurations

Pella Impervia composites are engineered to meet the performance class and grade shown in the design data tables in each product section. Composites are available in window types and configurations shown below. See the product sections for complete details.

Composite Configurations

Fixed Frame Direct Set



2-Wide Composite with Integral Mullion



3-Wide Composite with Integral Mullion

Fixed Window



2-Wide Composite with Integral Mullion

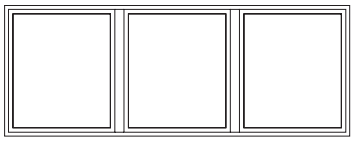

3-Wide Composite with Integral Mullion

Single-Hung



2-Wide Vent Composite with Integral Mullion



3-Wide (Equal) Vent Composite with Integral Mullion

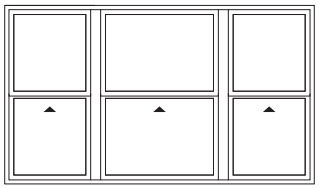

3-Wide (Unequal) Vent Composite with Integral Mullion

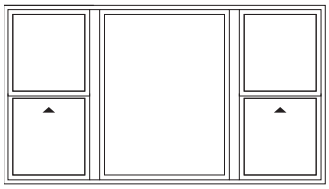

Fixed with Vent Flankers Composite with Integral Mullion

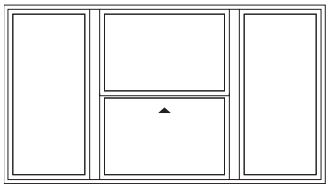

Vent with Fixed Flankers Composite with Integral Mullion

Typical Sealant Recommendations

Proper sealant placement is critical to window or door performance. See typical exterior and interior perimeter sealant details below.

Interior and Exterior Sealant Placement Detail

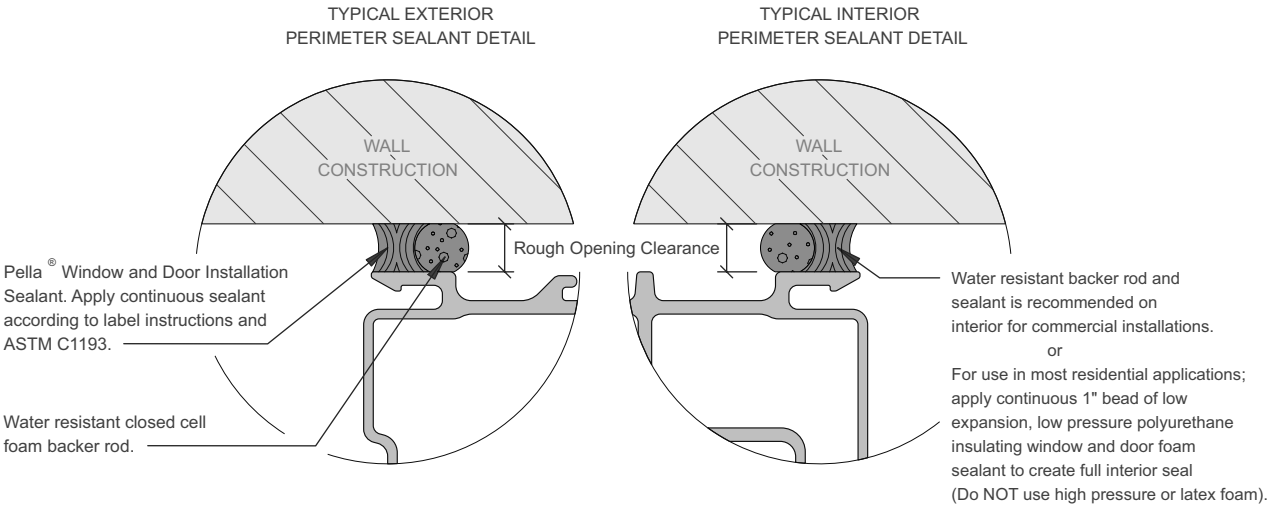

Recommended Rough Opening clearance shown above for a single window is 1/4" (1/2" total).
For combinations clearance should be 3/8" (3/4" total), for large combinations 1/2" (1" total).

When applying siding, brick veneer, stucco or other exterior finish material, leave adequate space between the unit frame and the exterior finish material for backer rod and sealant.

Note: The sealant details shown are standard recommendations from the sealant industry. Contact your sealant supplier for recommendations and instruction for this or any other application.

Single Unit Opening Recommendations

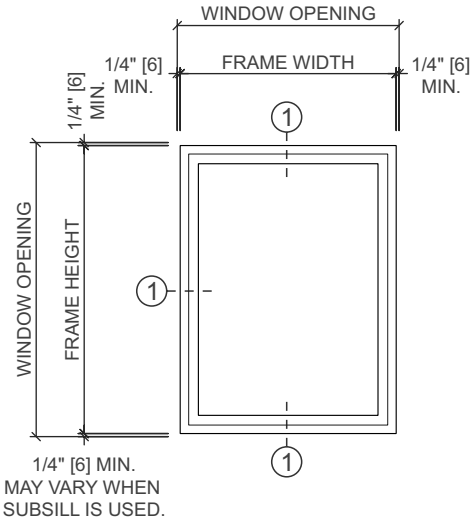

(1) To determine window openings for typical installations, add twice the rough opening clearance to the frame width and frame height. For large size units, openings with build up of multiple flashing materials, and/or in masonry construction, the need for additional rough opening clearances should be reviewed.

Typical installation details and accessories are shown in the Installation Details section.

Determine if unit performance meets design requirements. Unit performance limitations are in each product section.

See typical exterior and interior perimeter sealant details above. Proper sealant placement is critical to window performance.

Horizontal Window Combinations - Two-Way Vertical Joint Recommendations

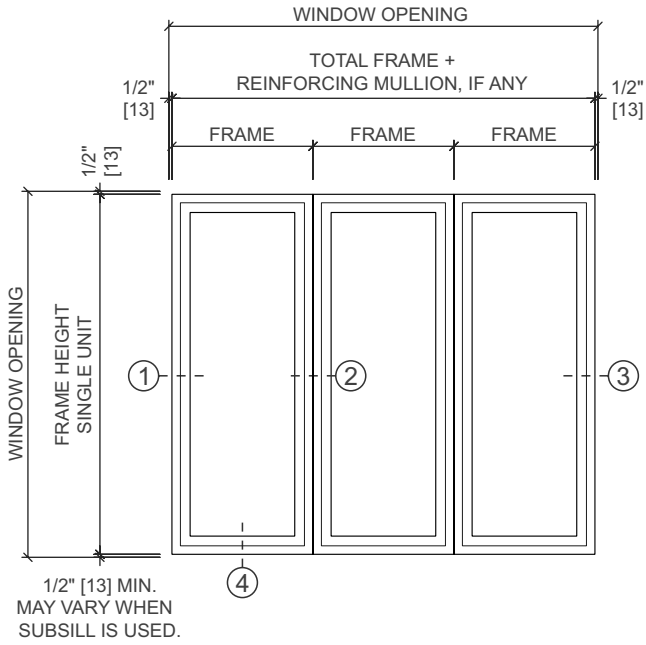

These recommendations apply to a typical horizontal combination of any vent or fixed unit of the same height to a maximum width of 20' without an expansion mullion.

Refer to single-unit opening recommendations in addition to the following:

(1) Minimum 3/8" clearance on smaller combination openings (See rough opening recommendations earlier in this section).

(2) Check if mullion reinforcement is required due to specified wind loading. (See mullion load charts later in this section).

(3) Minimum 1/2" clearance is recommended at each jamb for openings with three or more windows.

(4) Subsill systems that weep incidental moisture to the exterior are recommended for water management in openings where the potential for water infiltration is increased and may not be adequately managed by the building weather barrier, flashings and drainage system. Sample conditions include, but are not limited to: increased level of exposure due to multi-story construction, high weather exposure, recaulking would be difficult or unlikely, non-standard installation methods, or when there are multiple units joined within the opening.

Proper sealant placement is critical to window performance.

Vertical Window Combinations - Two-Way Horizontal Joint Recommendations

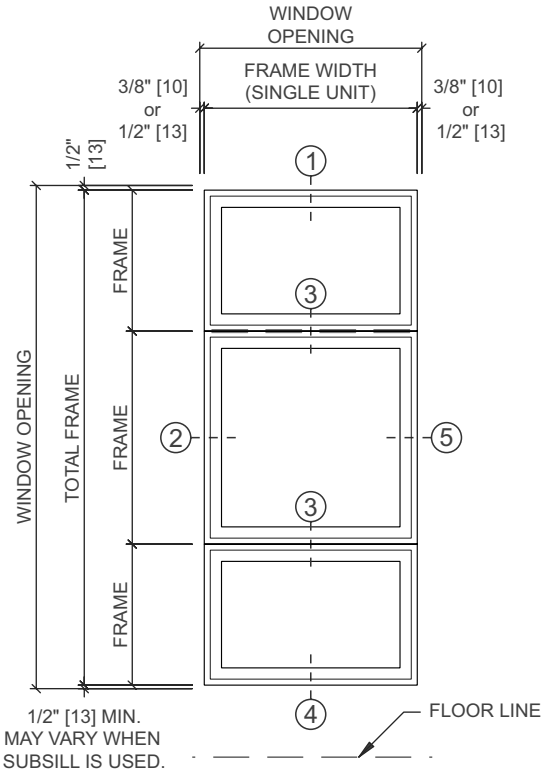

These recommendations apply to typical vertical stacking of vent or fixed units of the same width to a maximum height of 20' without intermediate support and expansion mullion cover.

Refer to single-unit opening recommendations in addition to the following:

(1) Intermediate dead load support is required as needed.

(2) 1/2" rough opening clearance is recommended for construction tolerances in large combinations.

(3) Check if reinforcing mullion is required due to specified wind loading and dead load (See mullion load charts later in this section).

(4) Subsill systems that weep incidental moisture to the exterior are recommended for water management in openings where the potential for water infiltration is increased and may not be adequately managed by the building weather barrier, flashings and drainage system. Sample conditions include, but are not limited to: increased level of exposure due to multi-story construction, high weather exposure, re-caulking would be difficult or unlikely, non-standard installation methods, or when there are multiple units joined within the opening.

(5) Pella® Impervia® windows require stacked units to be mulled together using proper combination mullion accessories prior to placing the windows in the rough opening. Practical consideration should be given to limiting the quantity of stacked units within a given height to an amount that can be safely handled by the installer without damage to the units and mullion integrity. The recommended number of units per stack is three or less.

Proper sealant placement is critical to window performance.

Three-Way Window Joint Recommendations

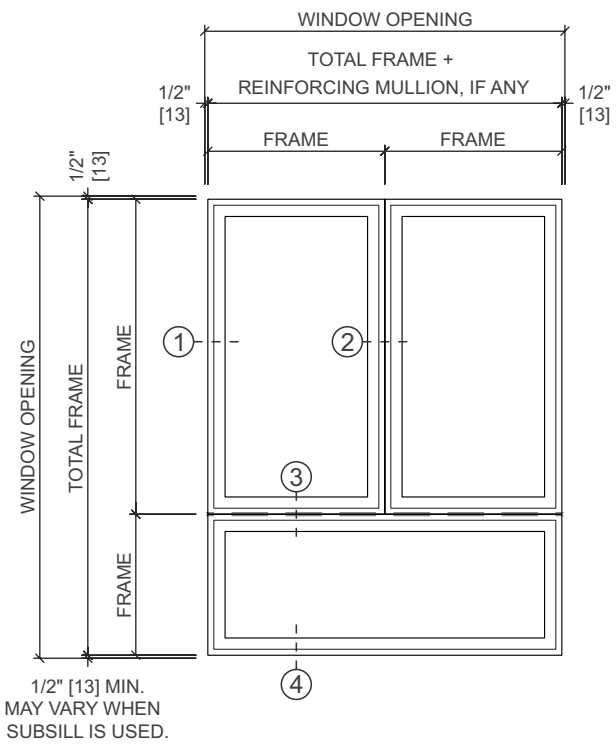

These recommendations apply to a typical grouping of any two vent or fixed units over one fixed unit that forms a three-way mullion intersection.

Refer to single-unit opening recommendations in addition to the following:

(1) 1/2" rough opening clearance is recommended in masonry construction and/or large combinations.

(2) Reinforcing mullion (see chart) or integral mullion (see product section for performance).

(3) Reinforcing mullion is required due to specified wind loading (See mullion load charts later in this section). Check both 2- and 3-way mullions.

(4) Subsill systems that weep incidental moisture to the exterior are recommended for water management in openings where the potential for water infiltration is increased and may not be adequately managed by the building weather barrier, flashings and drainage system. Sample conditions include, but are not limited to: increased level of exposure due to multi-story construction, high weather exposure, re-caulking would be difficult or unlikely, non-standard installation methods, or when there are multiple units joined within the opening.

Proper sealant placement is critical to window performance.

Four-Way Window Joint Recommendations

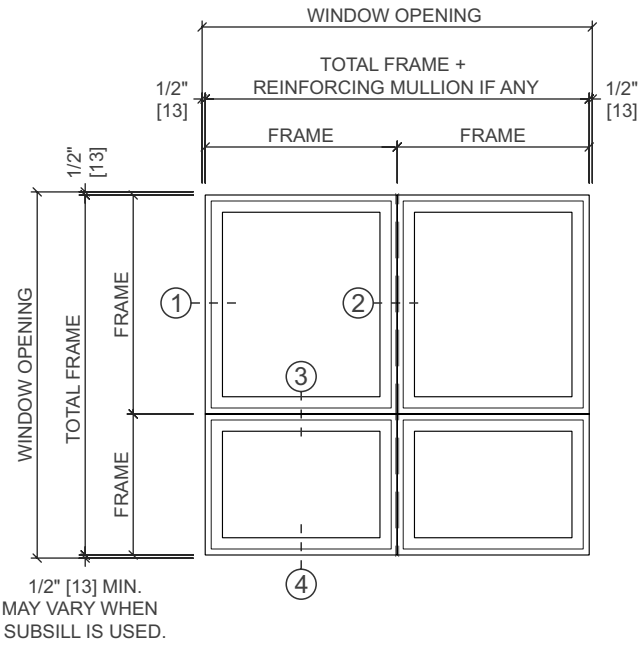

These recommendations apply to a typical grouping of any combination of window units that form a four-way mullion intersection.

Refer to single-unit opening recommendations in addition to the following:

(1) 1/2" rough opening clearance is recommended in masonry construction and/or when multiple units are installed within the same opening.

(2) All four-way mullion intersections require reinforcing mullion in one direction (either vertically or horizontally, see mullion load charts later in this section).

(3) Check two way combination mullion limitation for specified wind loading or Product section for composite with integral mullion.

(4) Subsill systems that weep incidental moisture to the exterior are recommended for water management in openings where the potential for water infiltration is increased and may not be adequately managed by the building weather barrier, flashings and drainage system. Sample conditions include, but are not limited to: increased level of exposure due to multi-story construction, high weather exposure, recaulking would be difficult or unlikely, non-standard installation methods, or when there are multiple units joined within the opening.

Proper sealant placement is critical to window performance.

Door to Door and Window to Door Recommendations

1. 1/2" clearance is recommended at the head of all doors.
2. 1/2" clearance is also recommended in masonry construction or large combinations.
3. Horizontal reinforcing mullion may be required above venting doors to carry weight of upper units and stiffen the mullion against wind loading.
4. Mullion intersections may require reinforcing mullion for two-way joints, reference mullion load charts later in this section.
5. Field framing may be required between Pella Impervia windows and door jambs, reference mullion load charts later in this section.

Proper sealant placement is critical to window and door performance.

Typical Configurations

Typical Window Combinations

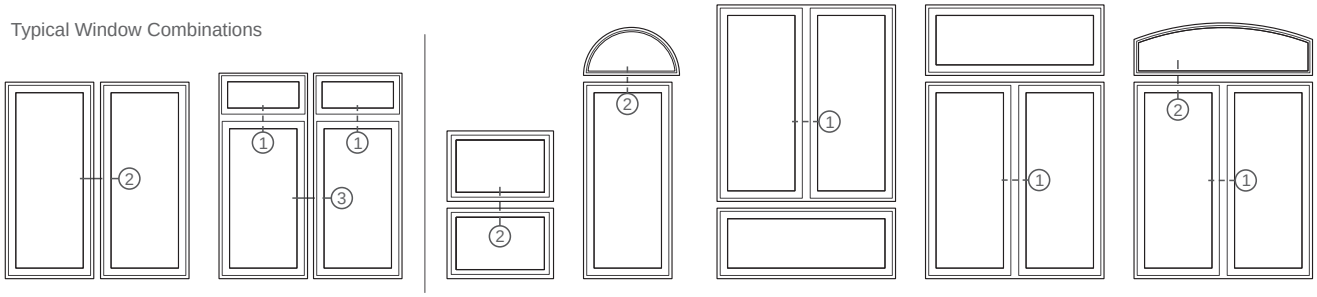

Horizontal Windows
Vertical Mullion

Vertical Windows
Horizontal Mullion

Three Way Windows
Horizontal Mullion

Typical Door Combinations

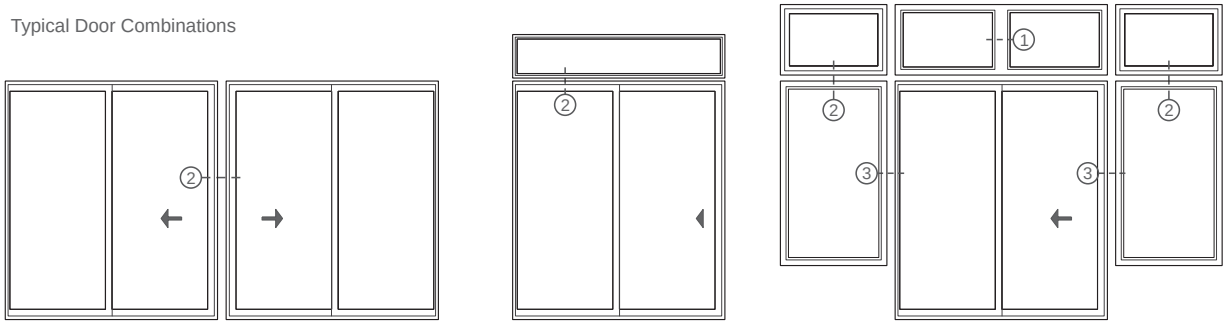

Horizontal Doors
Vertical Mullion

Vertical Door, Transom
Horizontal Mullion

Vertical Door, Transom w/ Side Light
Horizontal Mullion and Vertical Mullion

① Integral Mullion (Composite)
② Combination (Joining) Mullion or Reinforcing Mullion
③ Reinforcing Mullion Required

Vertical Window Mullion Component Parts and End Anchors

A1 - HEAD DRIP CAP

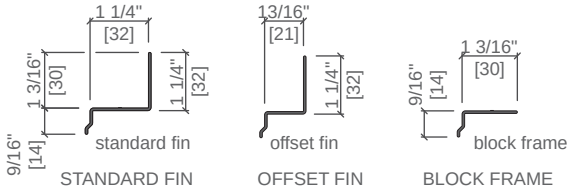

STANDARD FIN
#0CCL
KITS #01MV, 01MY

OFFSET FIN
#01JY
KITS #01MX, #01N0

BLOCK FRAME
#DES-000063300

A2 - MULLION SPLICES

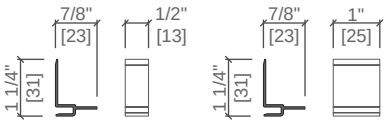

#51VW
1/2" MULLION

#51VX
1" MULLION

A3 - FOAM PLUGS



#51YA #51UN
1/2" PLUGS

#51YB #51UP
1" PLUGS

C1 - EXTERIOR MULLION COVERS

#70Z4
JOINING MULLION

#736M
1/2" MULLION

#736N
1" MULLION

C2 - INTERIOR MULLION COVERS

3" MULLIONS

#70Z4
JOINING MULLION

#51VT
1/2" MULLION

#51VU
1" MULLION

3 1/4" MULLIONS

#70Z4
TIGHT MULLION

#736M
1/2" MULLION

#736N
1" MULLION

MIXED MULLIONS 3" to 3 1/4"

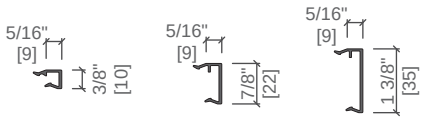

#51VP
JOINING MULLION

#51VQ
1/2" MULLION

#51VR
1" MULLION

S1 - SUBSILL



OUTER #01NG / INNER #01NF
ALL SUBSILL KITS

S2 - INTERIOR CLIP

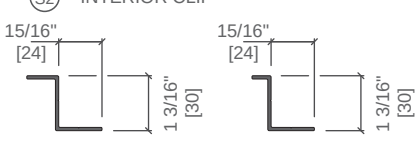

#01NJ
3" KIT #01N1, #01N2

#01NK
3 1/4" KIT #01N3, #01N4

R1 - STRUCTURAL MULLION



#51UL
1/2" MULLION

#51UM
1" MULLION

R3 - REINFORCEMENT



#51UK

R2 - MULLION END ANCHORS

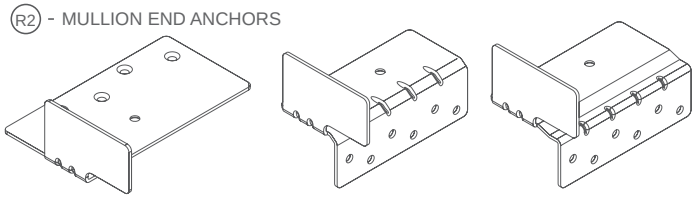

BLOCK FRAME
#51ZC

STANDARD FIN
LH #51UQ, RH #51UR

OFFSET FIN
LH #51US, RH 51UT

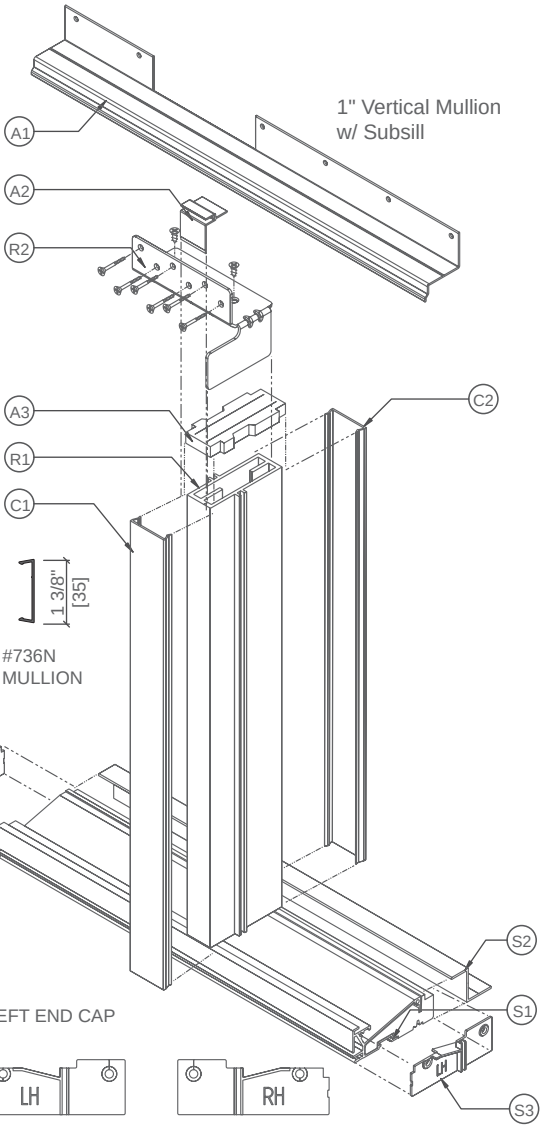

S3 - LEFT END CAP

#01NL
ALL SUBSILL KITS

#01NL
ALL SUBSILL KITS

Horizontal Window Mullion Component Parts and End Anchors

A1 - HEAD DRIP CAP

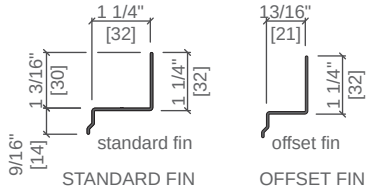

STANDARD FIN
#0CCL
KITS #01MV, 01MY

OFFSET FIN
#01JY
KITS #01MX, #01N0

A2 - MULLION SPLICES

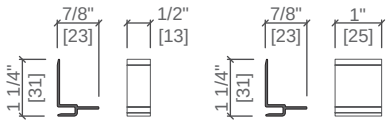

#51VW
1/2" MULLION

#51VX
1" MULLION

A3 - FOAM PLUGS

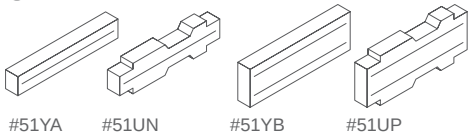

#51YA #51UN
1/2" PLUGS

#51YB #51UP
1" PLUGS

C1 - EXTERIOR MULLION COVERS

#70Z4
JOINING MULLION

#736M
1/2" MULLION

#736N
1" MULLION

C2 - INTERIOR MULLION COVERS

3" MULLIONS

#70Z4
JOINING MULLION

#51VT
1/2" MULLION

#51VU
1" MULLION

3 1/4" MULLIONS

#70Z4
TIGHT MULLION

#736M
1/2" MULLION

#736N
1" MULLION

MIXED MULLIONS 3" to 3 1/4"

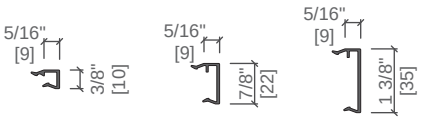

#51VP
JOINING MULLION

#51VQ
1/2" MULLION

#51VR
1" MULLION

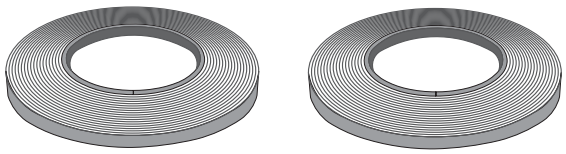

FOAM TAPE
#0CDZ

MULLION BUTYL TAPE
SEAL - 30' ROLL
#01JX

R1 - STRUCTURAL MULLION



#51UL
1/2" MULLION

#51UM
1" MULLION

R2 - MULLION END ANCHORS

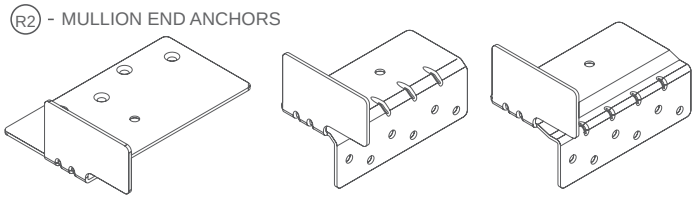

BLOCK FRAME
#51ZC

STANDARD FIN
LH #51UQ, RH #51UR

OFFSET FIN
LH #51US, RH 51UT

R3 - REINFORCEMENT



#51UK

1" Horizontal Mullion
w/ Reinforcing

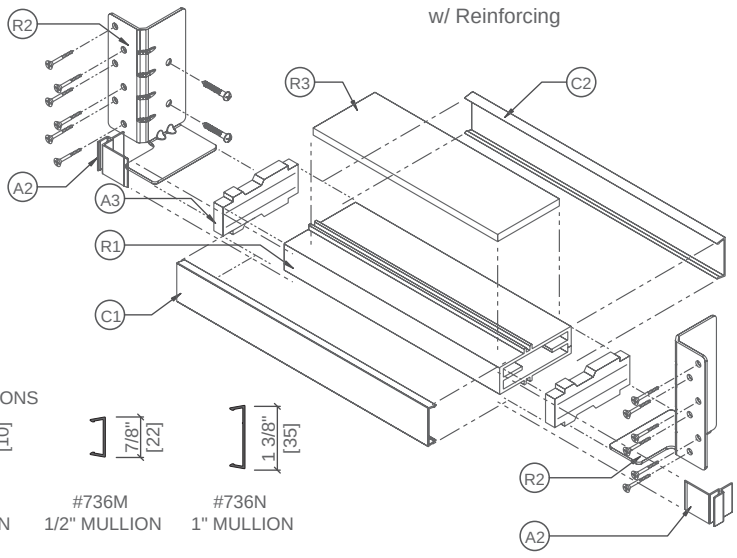

WINDOW MULLING PLATES

SINGLE-HUNG / DOUBLE-HUNG / SLIDING WINDOW
/ FIXED WINDOW & FIXED FRAME

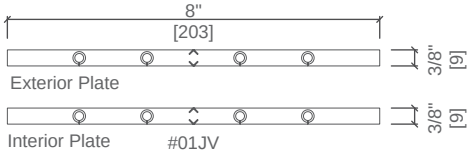

AWNING / CASEMENT

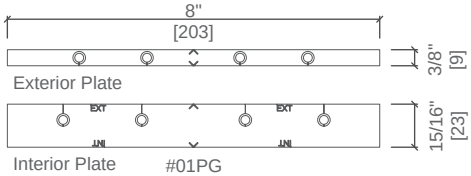

Vertical Door Mullion Component Parts and End Anchors

A1 - HEAD DRIP CAP

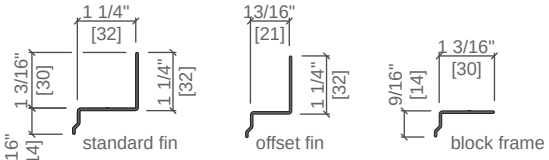

STANDARD FIN
#0CCL
KITS #01MV, 01MY

OFFSET FIN
#01JY
KITS #01MX, #01N0

BLOCK FRAME
#DES-000063300

A2 - MULLION SPLICES

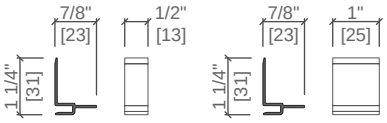

#51VW
1/2" MULLION

#51VX
1" MULLION

A3 - FOAM PLUGS



#51UN #523Q
1/2" PLUGS

#51UP #523R
1" PLUGS

FOAM TAPE



#81CY - JOINING MULLION
80SS - 1/2" and 1" MULLION

A4 - MULLION SILL SPLICE

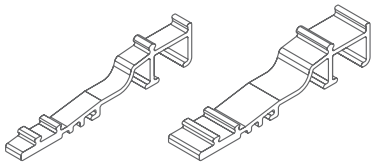

DES-000066675
1/2" mullion sill splice
#552FG000

DES-000066675
1" mullion sill splice
#552FG001

A5 - SILL SPLICE KEY



DES-000069517

A6 - STRIKE BRACKET

#524N

R1 - STRUCTURAL MULLION



#0AZD
1/2" DOOR



#0AZE
1" DOOR

R3 - REINFORCEMENT



#51UK

R2 - MULLION END ANCHORS

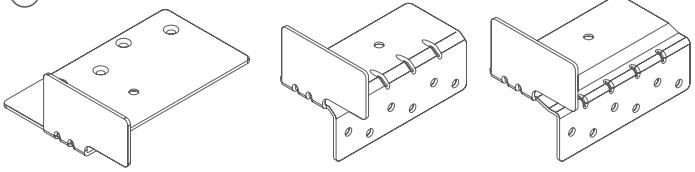

BLOCK FRAME
#51ZC

STANDARD FIN
LH #51UQ, RH #51UR

OFFSET FIN
LH #51US, RH 51UT

C1 - EXTERIOR COVERS

#70Z4
JOINING MULLION

#736M
1/2" MULLION

#736N
1" MULLION

C2 - INTERIOR COVERS

5" MULLIONS

#70Z4
JOINING MULLION

#736M
1/2" MULLION

#736N
1" MULLION

MIXED MULLIONS 3.25" to 5"

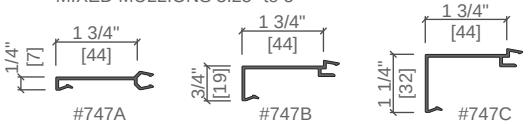

#747A
JOINING MULLION

#747B
1/2" MULLION

#747C
1" MULLION

MULLION PLATES

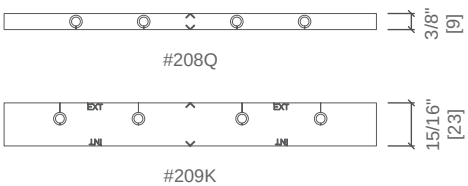

#208Q

#209K

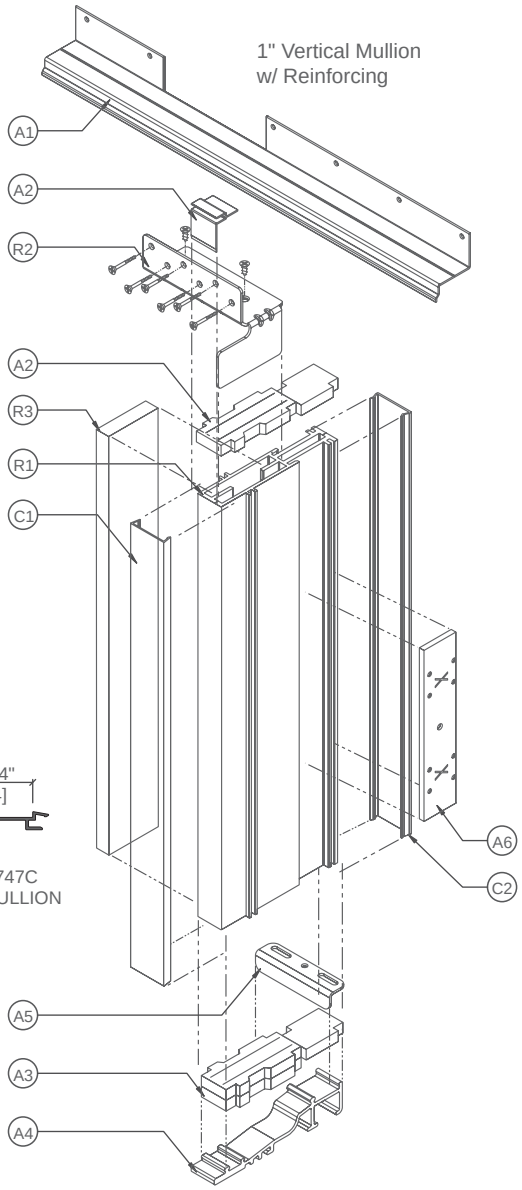

Horizontal Door Mullion Component Parts and End Anchors

A1 - HEAD DRIP CAP

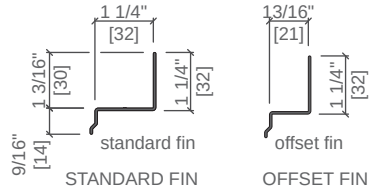

STANDARD FIN
#0CCL
KITS #01MV, 01MY

OFFSET FIN
#01JY
KITS #01MX, #01N0

A2 - MULLION SPLICES

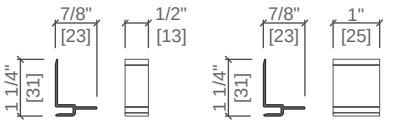

#51VW
1/2" MULLION

#51VX
1" MULLION

A3 - FOAM PLUGS



#51UN #523Q
1/2" PLUGS

#51UP #523R
1" PLUGS

C1 - EXTERIOR COVERS

#70Z4
JOINING MULLION

#736M
1/2" MULLION

#736N
1" MULLION

C2 - INTERIOR COVERS

5" MULLIONS

#70Z4
JOINING MULLION

#736M
1/2" MULLION

#736N
1" MULLION

MIXED MULLIONS 3.25" to 5"

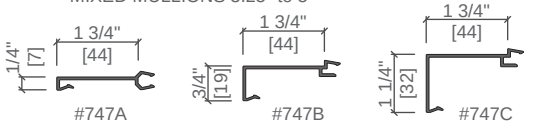

#747A
JOINING MULLION

#747B
1/2" MULLION

#747C
1" MULLION

MULLION PLATES

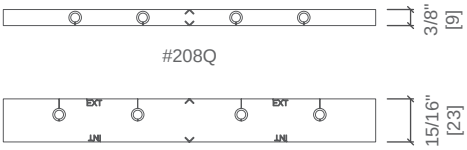

#209K

R1 - STRUCTURAL MULLION

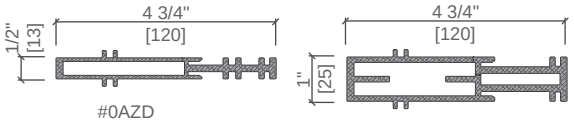

R2 - MULLION END ANCHORS

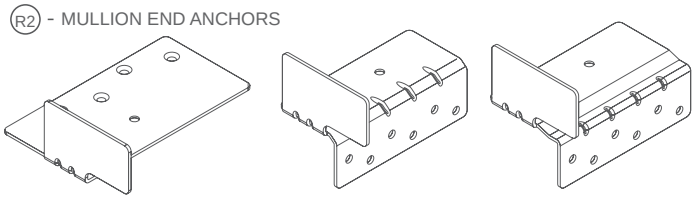

BLOCK FRAME
#51ZC

STANDARD FIN
LH #51UQ, RH #51UR

OFFSET FIN
LH #51US, RH 51UT

R3 - REINFORCEMENT



#51UK

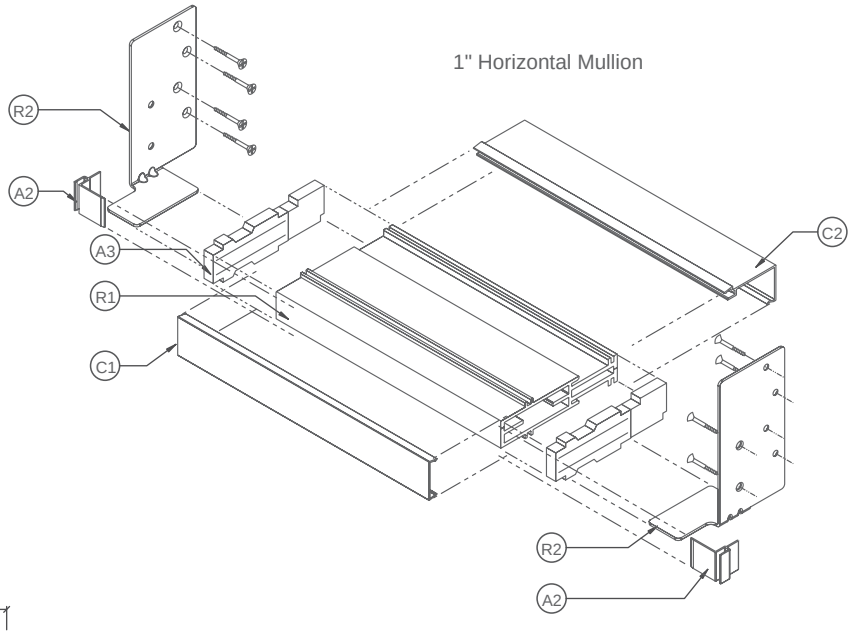

FOAM TAPE



#81CY - JOINING MULLION
80SS - 1/2" and 1" MULLION

Combination End Anchor Capacities

MULLION END ANCHORS

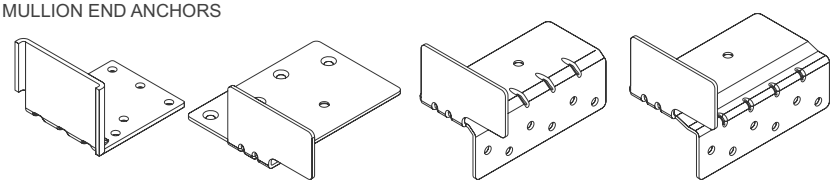

BLOCK FRAME
LH #51V9, RH #51VA

BLOCK FRAME
#51UU

STANDARD FIN
LH #51UQ, RH #51UR

OFFSET FIN
LH #51US, RH 51U1

Window and Door 1/2" & 1" Aluminum Structural Mullion Nail Fin and Offset Nail Fin End Anchors — 51UQ, 51UR, 51US, 51U1

Rough Opening Substrate	Maximum Qty of Fasteners	Type of Fastener	Capacity (lbs)
Wood	6	#8 Stainless Steel Wood Screw, 2" Embedment	1572
Light Gauge Steel (20 Ga.)	6	#10-16 Hex Washer Head Sheet Metal Screw, 3 embedded threads	504
Concrete	NA	Not Recommended	NA

Window and Door 1/2" & 1" Aluminum Structural Mullion Block Frame End Anchor — 51UU

Rough Opening Substrate	Maximum Qty of Fasteners	Type of Fastener	Capacity (lbs)
Wood	4	#8 Stainless Steel Wood Screw, 2" Embedment	576
Light Gauge Steel (20 Ga.)	4	#10-16 Hex Washer Head Sheet Metal Screw, 3 embedded threads	708
Concrete	4	3/16" Tapcon-Type Screw Anchor, 1.25" embedment	596

Window 1/2" & 1" Aluminum Structural Mullion Ribbon End Anchor (for assembly in the opening) — 51V9, 51VA

Rough Opening Substrate	Maximum Qty of Fasteners	Type of Fastener	Capacity (lbs)
Wood	7	#10 Stainless Steel Wood Screw, 2" Embedment	1246
Light Gauge Steel (20 Ga.)	7	#10-16 Hex Washer Head Sheet Metal Screw, 3 embedded threads	1239
Concrete	4	3/16" Tapcon-Type Screw Anchor, 1.25" embedment	420

Use the following to determine end anchors for Pella reinforcing options.

To Calculate End Load At Mullion Reinforcement:

Load per end = [(A + B) x L x P] / 2

A = Half the distance in feet from the mullion for which the loading is being figured to the next structural member to the left.

B = Half the distance in feet from the mullion for which the loading is being figured to the next structural member to the right.

P = Design wind load pressure required for the building project in pounds per square foot.

L = Mullion length in feet.

Door and Window Typical Combinations - Sample Calculations

The following sample calculations are based on steps 1-8 on page 3.

1. **Determine the overall size of the configuration of the combination or composite.**

Product: Pella® Impervia® Fixed Frame Direct Set Window

(1) Integral Mullion

(2) Mullion type to be determined

(3) Mullion type to be determined

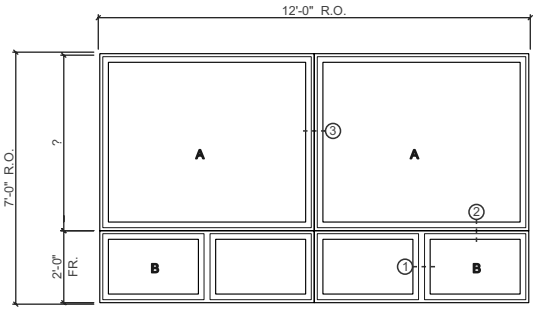

2. **Determine the required windload (design pressure).**

Project description:

Location: Pella, IA

Based on in ASCE 7-16, Minimum Design Loads for Buildings and Other Structures

Wind speed = 109 mph, Exposure C

Design Pressure: 25 psf

3. **Determine individual window / door size and performance (nominal sizing).**

Individual Window Performance: Unit A

Project design pressure: 25 psf

Required window / door performance class and grade rating: R25

Applicable Product – Pella Impervia Fixed Frame Direct Set

Individual window size and performance:

Performance Class and Grade = CW-PG50

Therefore selected windows meet design pressure requirements.

Individual Window Performance: Unit B

Project design pressure: 25 psf

Required window / door performance class and grade rating: R25

Applicable Product - Pella Impervia 2-Wide Impervia Fixed Frame Direct Set Composite Window with Integral Mullion.

Performance Class and Grade = CW-PG50

(1) - Integral Mullion

Therefore selected windows meet design pressure requirements.

4. **Determine glazing performance:**

Glazing performance is validated by using Pella Quote Management System.

Requirements for glass thickness will vary depending on the size of the unit

Selected window glazing must have sufficient load resistance to withstand the project design pressure requirements, per ASTM E1300.

5. **Determine if the combination will be factory assembled or non-factory assembled.**

For this example, portions of the window assembly are factory assembled and some are non-factory assembled.

6. **Determine mullion types and reinforcement requirements:**

Windload (lateral loading) YES if yes, joint type: Joint (2) = two-way joint

Joint (3) = four-way joint

Dead Load (above doors and awnings) Not Applicable.

Continued on next page

7. Determine the appropriate mullion reinforcing:

(See pages 3–6 in this section for notes and instructions)

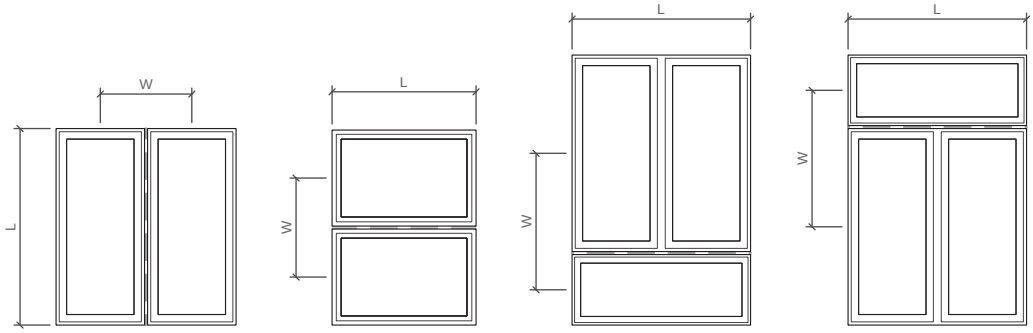

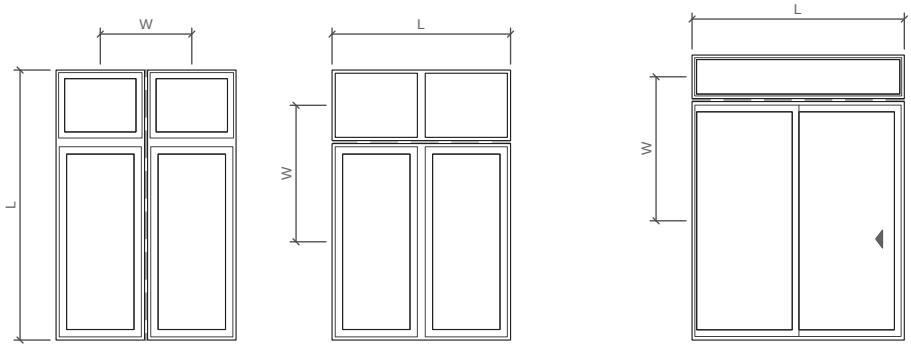

Determine reinforcing mullion for joint (2) (horizontal mullion) = two way	Joint (2)
A. Determine L = Mullion length (in)	72"
B. Determine W = Windload width (in)	42"
a. 1/2 the distance from the mullion to the member above = 30"	
b. 1/2 the distance from the mullion to the member below = 12"	
C. Determine minimum reinforcing mullion required	
Step [1] Enter the graph at the point of the mullion length (L).	Use 72"
Step [2] Move to the loading width (W).	Use 48"
Step [3] Move right to the column with the design pressure.	Use 25 psf

MAXIMUM ALLOWABLE DESIGN PRESSURE (PSF)

L (in)	W (in)	20	25	30	35	40	45	50
72	24	A	A	A	B	B	B	B
72	28	A	A	B	B	B	B	B
72	30	A	B	B	B	B	B	B
72	36	A	B	B	B	B	C	D
72	48	B	B	B	D	D	D	D
72	54	B	B	C	D	D	D	F
72	60	B	B	D	D	D	F	F

3 — 25 — 1 — 72 — 48 — 2

See actual mullion load charts in this section for details.

Reinforcing mullion results:

Joint (2) : Minimum reinforcing mullion B = 1/2" Structural Mullion. We will use E = 2- 2x4 wood studs for this example.

Continued on next page

Door and Window Typical Combinations - Sample Calculations

Determine reinforcing mullion for joint ③ = four-way joint — Joint ③

A. Determine L = Mullion length (in) — 84"

B. Determine W = Windload width (in) — 72"

a. 1/2 the distance from the mullion to the left member = 36"

b. 1/2 the distance from the mullion to the right member = 36"

C. Determine minimum reinforcing mullion required

Step 1 Enter the graph at the point of the mullion length (L). — Use 96"

Step 2 Move to the loading width (W). — Use 72"

Step 3 Move right to the column with the design pressure. — Use 25 psf

Minimum reinforcing mullion:

I = 1" structural Mullion with 2 Reinforcements

We will use K = 2- 2x6 wood studs for this example.

MAXIMUM ALLOWABLE DESIGN PRESSURE (PSF)								
L (in)	W (in)	20	25	30	35	40	45	50
96	30	D	D	E	F	G	G	G
96	36	D	E	F	G	G	H	I
96	48	F	G	G	I	I	I	J
96	54	F	G	H	I	I	J	K
96	60	G	G	I	I	J	K	K
96	66	G	I	I	J	K	K	L
96	72	G	I	I	J	K	L	L

See actual mullion load charts in this section for details.
(—) = Not Applicable

8. Determine actual rough opening size and window data:

Rough Opening Width:	EXAMPLE:
Rough Opening	144"
Jamb Clearance (1/4" x 2)	- 1/2"
Number of vertical mullions x (mullion reinforcement width + clearance when required) (3" x 1) + (1/4" x 2)	-3-1/2"
Total Window width	140"
Window width ÷ number of windows	70"

Rough Opening Height:	EXAMPLE:
Rough Opening	84"
Sill and head clearance (1/4" x 2)	- 1/2"
Number of horizontal mullions x (reinforcing mullion width + clearance when required) (3" x 1) + (1/4" x 2)	-3-1/2"
Total unit height (Use 4'8" frame height over 2'0" frame height units)	80"

Final Layout and Detail:

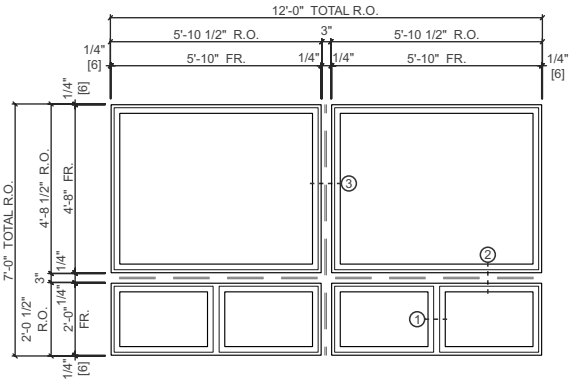

① Integral Mullion

② 2 - 2" x 4" Nominal Wood Reinforcing Mullion

③ 2 - 2" x 6" Nominal Wood Reinforcing Mullion

Impervia® Combinations

Two-Way Mullion of any Combination of Rectangle Windows

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
42	60	A	A	A	A	A	A	A
42	66	A	A	A	A	A	A	A
42	72	A	A	A	A	A	A	A
48	36	A	A	A	A	A	A	A
48	48	A	A	A	A	A	A	A
48	54	A	A	A	A	A	A	B
48	60	A	A	A	A	A	B	B
48	66	A	A	A	A	B	B	B
48	72	A	A	A	B	B	B	B
54	28	A	A	A	A	A	A	A
54	30	A	A	A	A	A	A	A
54	36	A	A	A	A	A	A	B
54	48	A	A	A	A	B	B	B
54	54	A	A	A	B	B	B	B
54	60	A	A	B	B	B	B	B
54	66	A	A	B	B	B	B	B
54	72	A	B	B	B	B	B	B
60	18	A	A	A	A	A	A	A
60	24	A	A	A	A	A	A	A
60	28	A	A	A	A	A	B	B
60	30	A	A	A	A	A	B	B
60	36	A	A	A	B	B	B	B
60	48	A	A	B	B	B	B	B
60	54	A	B	B	B	B	B	C
60	60	A	B	B	B	B	C	D
60	66	B	B	B	B	B	D	D
60	72	B	B	B	B	D	D	D
72	18	A	A	A	A	A	B	B
72	24	A	A	A	B	B	B	B
72	28	A	A	B	B	B	B	B
72	30	A	B	B	B	B	B	B
72	36	A	B	B	B	B	C	D
72	48	B	B	B	D	D	D	D
72	54	B	B	C	D	D	D	F
72	60	B	B	D	D	D	F	F
72	66	B	D	D	D	F	F	G
72	72	B	D	D	E	F	G	G
78	18	A	A	A	B	B	B	B
78	24	A	B	B	B	B	B	B
78	28	A	B	B	B	B	C	D
78	30	B	B	B	B	B	D	D
78	36	B	B	B	C	D	D	D
78	48	B	B	D	D	D	F	F
78	54	B	D	D	D	F	F	G
78	60	B	D	D	F	F	G	G
78	66	D	D	E	F	G	G	H
78	72	D	D	F	G	G	H	I
84	18	A	A	B	B	B	B	B
84	24	B	B	B	B	B	D	D
84	28	B	B	B	C	D	D	D
84	30	B	B	B	D	D	D	D
84	36	B	B	D	D	D	F	F
84	48	B	D	D	F	F	G	G
84	54	D	D	F	F	G	G	I
84	60	D	D	F	G	G	I	I
84	66	D	F	G	G	H	I	I
84	72	D	F	G	G	I	I	J

Continued on next page



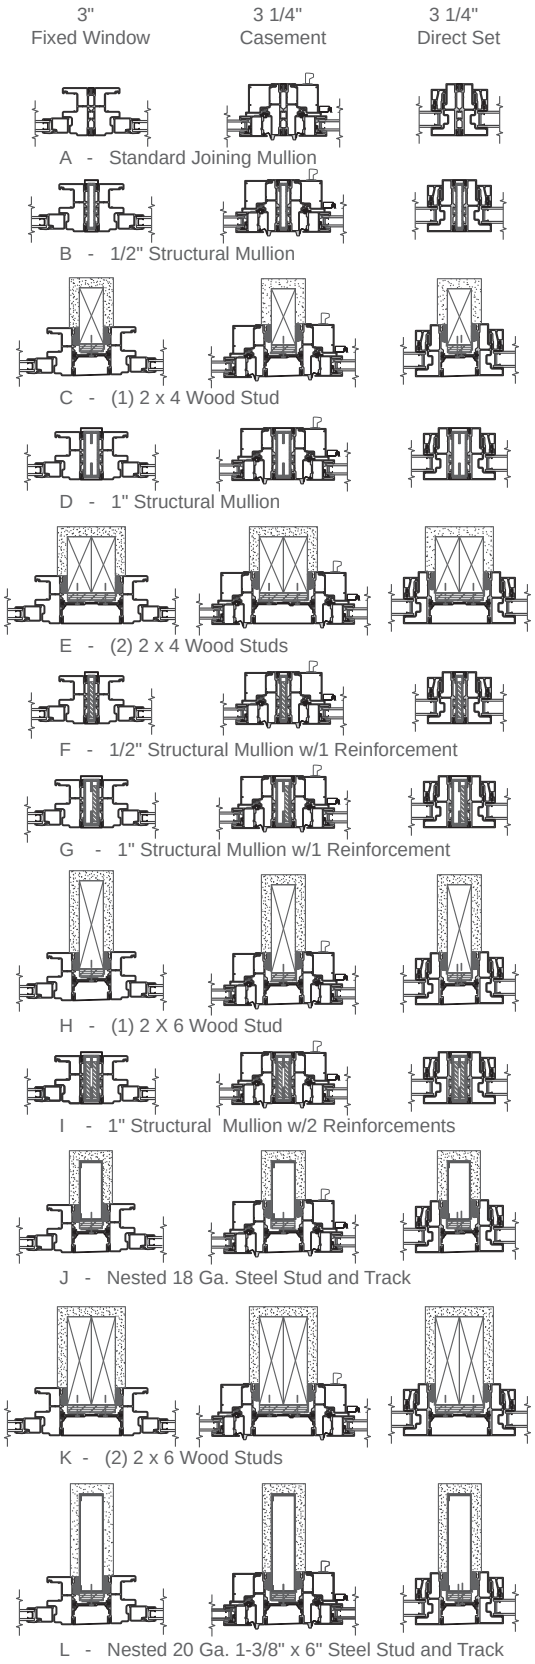

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Impervia® Combinations

Two-Way Mullion of any combination of Rectangle Windows

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
90	18	A	B	B	B	B	C	D
90	24	B	B	B	D	D	D	D
90	28	B	B	D	D	D	D	F
90	30	B	B	D	D	D	F	F
90	36	B	D	D	D	F	G	G
90	48	D	D	F	G	G	H	I
90	54	D	F	G	G	H	I	I
90	60	D	F	G	H	I	I	J
90	66	F	G	G	I	I	J	J
90	72	F	G	H	I	I	J	K
96	18	B	B	B	B	D	D	D
96	24	B	B	D	D	D	F	F
96	28	B	D	D	D	F	F	G
96	30	B	D	D	E	F	G	G
96	36	D	D	F	F	G	G	I
96	48	D	F	G	G	I	I	J
96	54	F	G	G	I	I	J	J
96	60	F	G	I	I	J	J	K
96	66	G	G	I	I	J	K	L
96	72	G	I	I	J	K	K	L
108	18	B	B	D	D	D	F	F
108	24	C	D	D	F	G	G	G
108	28	D	D	F	G	G	I	I
108	30	D	E	F	G	G	I	I
108	36	D	F	G	I	I	I	J
108	48	G	G	I	J	J	K	L
108	54	G	I	I	J	K	L	L
108	60	G	I	J	K	L	L	L
108	66	I	I	K	L	L	L	L
108	72	I	J	K	L	L	L	L



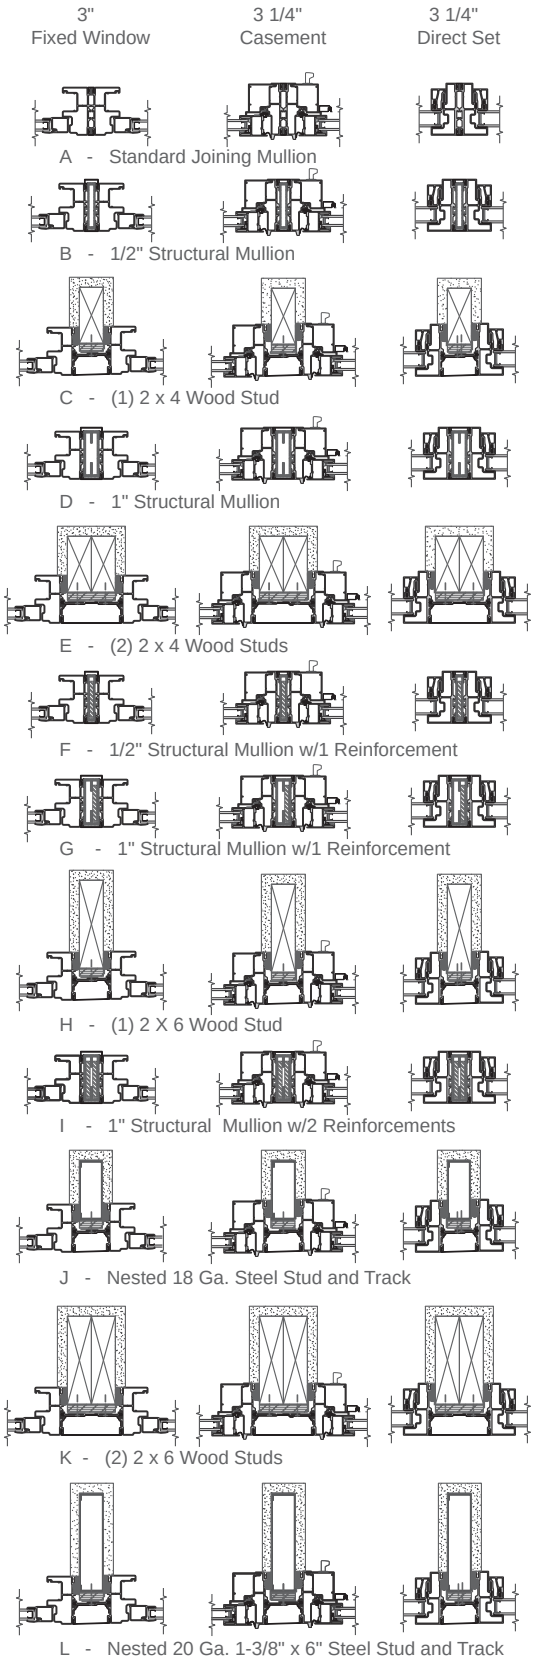

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Three-Way Mullion of any combination of Rectangle Windows

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
42	60	A	A	A	B	B	B	B
42	66	A	A	B	B	B	B	B
42	72	A	A	B	B	B	B	B
48	36	A	A	A	B	B	B	B
48	48	A	A	B	B	B	B	B
48	54	A	B	B	B	B	B	B
48	60	A	B	B	B	B	B	B
48	66	B	B	B	B	B	B	B
48	72	B	B	B	B	B	B	B
54	28	A	A	A	B	B	B	B
54	30	A	A	B	B	B	B	B
54	36	A	B	B	B	B	B	B
54	48	B	B	B	B	B	B	B
54	54	B	B	B	B	B	B	B
54	60	B	B	B	B	B	B	C
54	66	B	B	B	B	B	C	D
54	72	B	B	B	B	C	D	D
60	18	A	A	A	B	B	B	B
60	24	A	A	B	B	B	B	B
60	28	A	B	B	B	B	B	B
60	30	A	B	B	B	B	B	B
60	36	B	B	B	B	B	B	B
60	48	B	B	B	B	B	C	D
60	54	B	B	B	B	C	D	D
60	60	B	B	B	C	D	D	D
60	66	B	B	B	D	D	D	D
60	72	B	B	C	D	D	D	D
72	18	A	B	B	B	B	B	B
72	24	B	B	B	B	B	B	C
72	28	B	B	B	B	B	C	D
72	30	B	B	B	B	C	D	D
72	36	B	B	B	C	D	D	D
72	48	B	C	D	D	D	E	F
72	54	B	D	D	D	E	F	F
72	60	C	D	D	D	F	F	G
72	66	D	D	D	F	F	G	G
72	72	D	D	E	F	G	G	G
78	18	B	B	B	B	B	B	B
78	24	B	B	B	B	C	D	D
78	28	B	B	B	C	D	D	D
78	30	B	B	B	D	D	D	D
78	36	B	B	D	D	D	D	F
78	48	C	D	D	E	F	F	G
78	54	D	D	D	F	F	G	G
78	60	D	D	F	F	G	G	H
78	66	D	D	F	G	G	H	I
78	72	D	F	F	G	G	I	I

Continued on next page

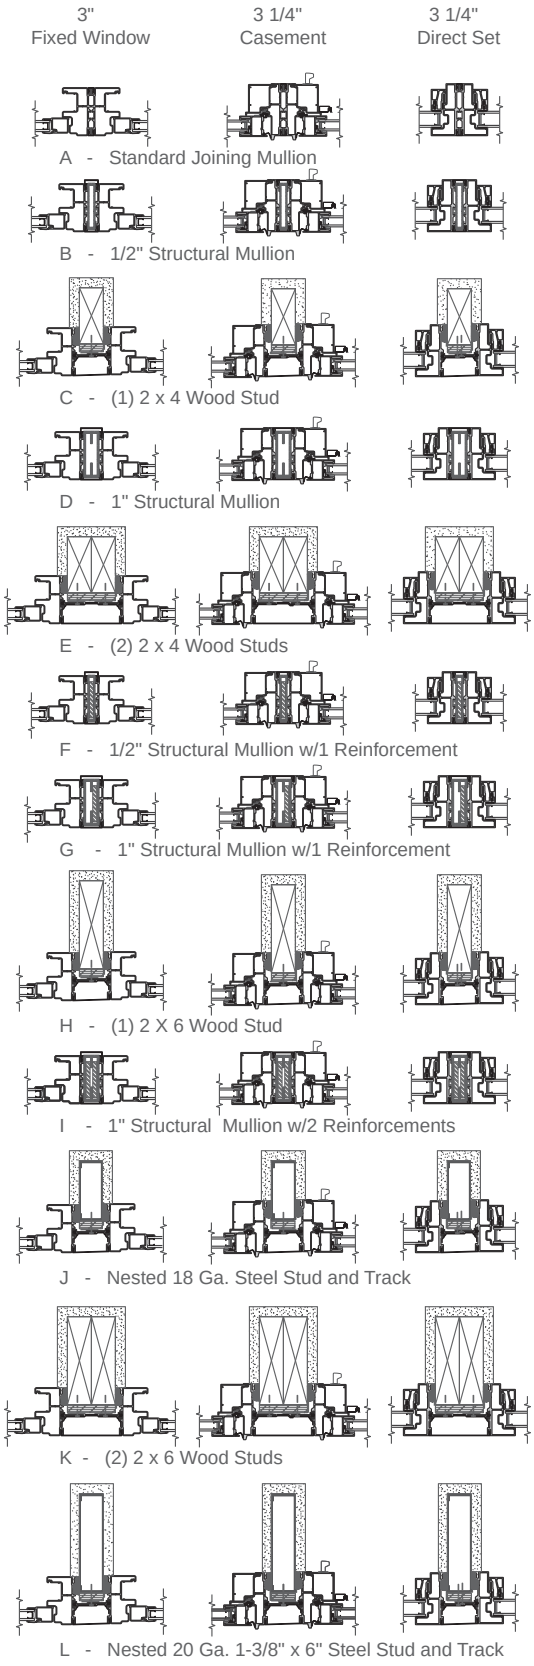

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Impervia® Combinations

Three-Way Mullion of any combination Rectangle Windows

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
84	18	B	B	B	B	B	D	D
84	24	B	B	B	D	D	D	D
84	28	B	B	D	D	D	D	F
84	30	B	C	D	D	D	E	F
84	36	B	D	D	D	F	F	G
84	48	D	D	F	F	G	G	H
84	54	D	E	F	G	G	H	I
84	60	D	F	G	G	H	I	I
84	66	D	F	G	G	I	I	I
84	72	F	G	G	I	I	I	J
90	18	B	B	B	C	D	D	D
90	24	B	C	D	D	D	E	F
90	28	B	D	D	D	F	F	F
90	30	C	D	D	D	F	F	G
90	36	D	D	E	F	G	G	G
90	48	D	F	G	G	H	I	I
90	54	E	F	G	G	I	I	I
90	60	F	G	G	I	I	I	J
90	66	F	G	H	I	I	J	K
90	72	G	G	I	I	J	K	K
96	18	B	B	D	D	D	D	E
96	24	B	D	D	D	F	F	G
96	28	D	D	D	F	F	G	G
96	30	D	D	E	F	G	G	G
96	36	D	E	F	G	G	H	I
96	48	F	G	G	I	I	I	J
96	54	F	G	H	I	I	J	K
96	60	G	G	I	I	J	K	K
96	66	G	I	I	J	K	K	L
96	72	G	I	I	J	K	L	L
108	18	C	D	D	E	F	F	G
108	24	D	D	F	G	G	G	I
108	28	D	F	G	G	H	I	I
108	30	D	F	G	G	I	I	I
108	36	F	G	G	I	I	J	J
108	48	G	I	I	J	K	K	L
108	54	G	I	J	K	K	L	L
108	60	I	I	J	K	L	L	L
108	66	I	J	K	L	L	L	L
108	72	I	J	K	L	L	L	L

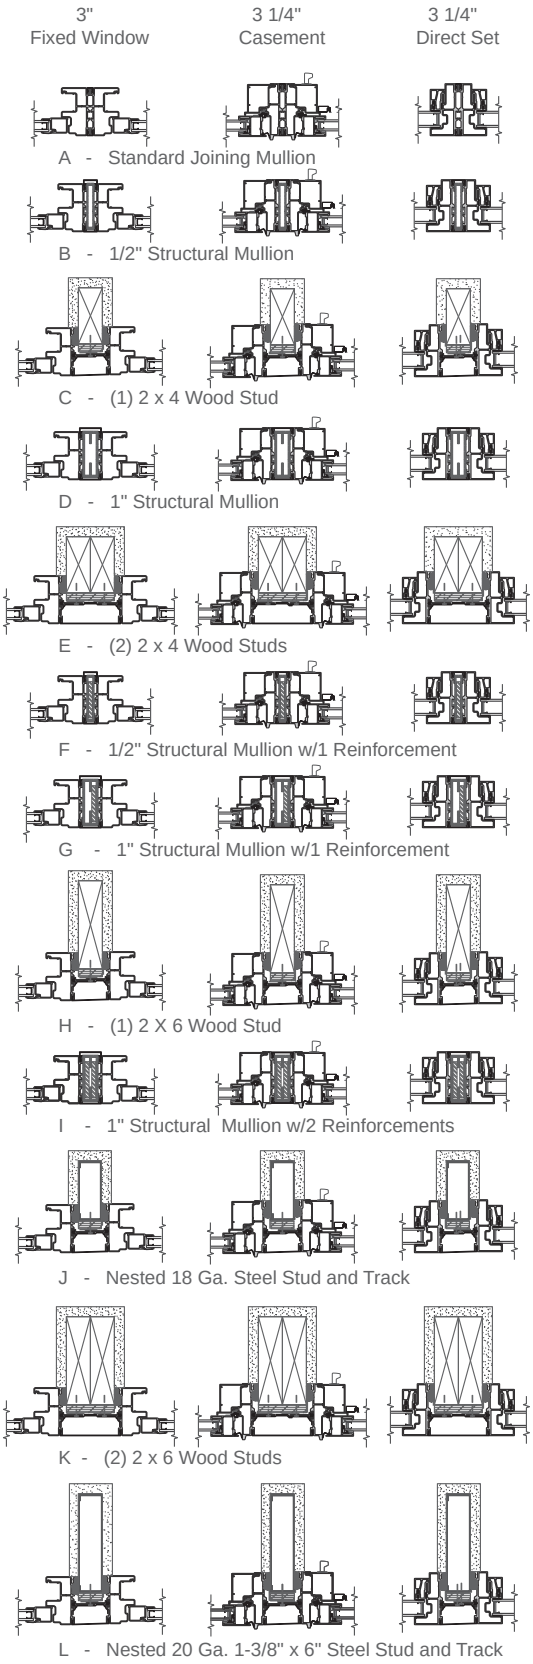

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Impervia® Combinations

Four-Way Mullion any combination or Rectangle Windows

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
42	60	B	B	B	B	B	B	B
42	66	B	B	B	B	B	B	D
42	72	B	B	B	B	B	D	D
48	36	B	B	B	B	B	B	B
48	48	B	B	B	B	B	B	B
48	54	B	B	B	B	B	D	D
48	60	B	B	B	B	B	D	D
48	66	B	B	B	B	D	D	D
48	72	B	B	B	D	D	D	D
54	28	B	B	B	B	B	B	B
54	30	B	B	B	B	B	B	B
54	36	B	B	B	B	B	B	B
54	48	B	B	B	B	D	D	D
54	54	B	B	B	B	D	D	D
54	60	B	B	B	D	D	D	D
54	66	B	B	D	D	D	D	D
54	72	B	B	D	D	D	D	D
60	18	B	B	B	B	B	B	B
60	24	B	B	B	B	B	B	B
60	28	B	B	B	B	B	B	C
60	30	B	B	B	B	B	B	C
60	36	B	B	B	B	C	D	D
60	48	B	B	C	D	D	D	D
60	54	B	B	D	D	D	D	F
60	60	B	C	D	D	D	D	D
60	66	B	D	D	D	D	D	F
60	72	C	D	D	D	D	F	F
72	18	B	B	B	B	B	C	C
72	24	B	B	B	C	D	D	D
72	28	B	B	C	D	D	D	D
72	30	B	B	C	D	D	D	D
72	36	B	C	D	D	D	D	E
72	48	D	D	D	D	F	F	F
72	54	D	D	D	F	F	G	G
72	60	D	D	E	F	F	G	G
72	66	D	D	F	F	G	G	G
72	72	D	E	F	G	G	G	I
78	18	B	B	B	B	D	D	D
78	24	B	B	D	D	D	D	D
78	28	B	C	D	D	D	D	E
78	30	B	D	D	D	D	D	F
78	36	D	D	D	D	F	F	F
78	48	D	D	F	F	G	G	G
78	54	D	D	F	F	G	G	H
78	60	D	F	F	G	G	H	I
78	66	D	F	G	G	H	I	I
78	72	F	F	G	G	I	I	I
84	18	B	B	C	D	D	D	D
84	24	B	D	D	D	D	D	F
84	28	C	D	D	D	E	F	F
84	30	D	D	D	D	F	F	F
84	36	D	D	D	F	F	G	G
84	48	D	F	F	G	G	H	I
84	54	D	F	G	G	H	I	I
84	60	F	F	G	G	I	I	I
84	66	F	G	G	I	I	I	J
84	72	F	G	H	I	I	J	J

Continued on next page

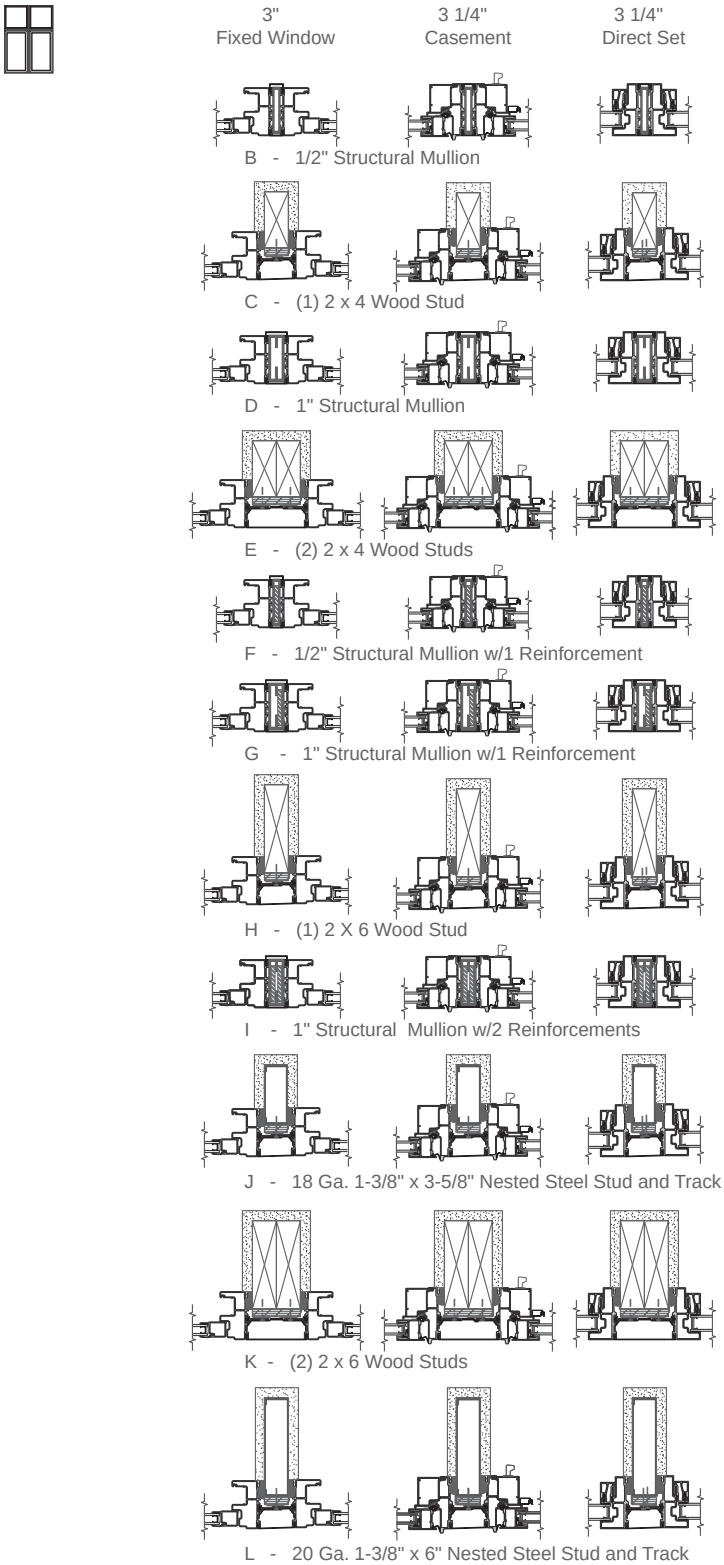

(—) = Not Applicable

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Four-Way Mullion any combination Rectangle Windows

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
90	18	B	C	D	D	D	D	E
90	24	D	D	D	D	F	F	F
90	28	D	D	D	F	F	G	G
90	30	D	D	E	F	F	G	G
90	36	D	E	F	G	G	G	H
90	48	F	F	G	G	I	I	I
90	54	F	G	G	I	I	I	J
90	60	F	G	H	I	I	J	K
90	66	G	G	I	I	J	J	K
90	72	G	H	I	I	J	K	K
96	18	C	D	D	D	D	F	F
96	24	D	D	D	F	F	G	G
96	28	D	D	F	F	G	G	G
96	30	D	E	F	G	G	G	I
96	36	D	F	G	G	H	I	I
96	48	F	G	H	I	I	J	J
96	54	G	G	I	I	J	J	K
96	60	G	I	I	J	J	K	L
96	66	G	I	I	J	K	K	L
96	72	H	I	J	K	K	L	—
108	18	D	D	F	F	G	G	G
108	24	D	F	G	G	G	I	I
108	28	F	F	G	G	I	I	I
108	30	F	G	G	I	I	I	J
108	36	G	G	I	I	I	J	K
108	48	G	I	I	J	K	L	L
108	54	I	I	J	K	L	L	L
108	60	I	J	K	L	L	L	—
108	66	I	J	K	L	L	—	—
108	72	I	K	L	L	—	—	—

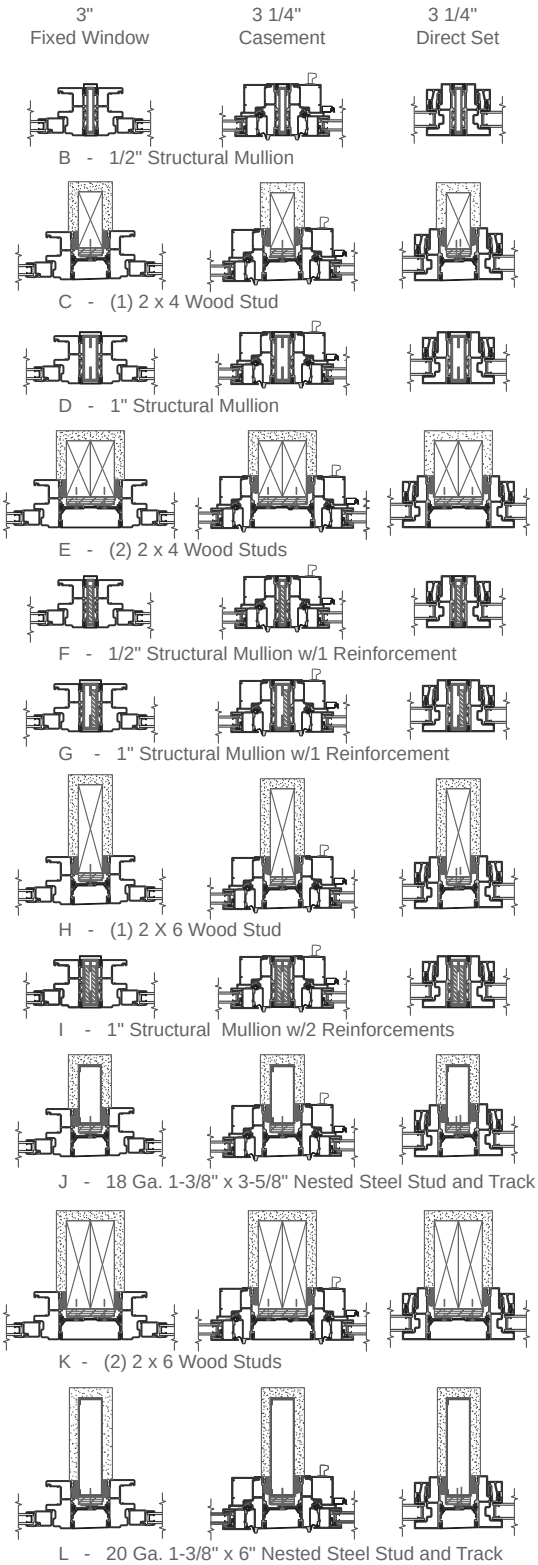

(—) = Not Applicable

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Two-Way Mullion of Rectangle Window to Special Shape

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
42	60	A	A	A	B	B	B	B
42	66	A	A	A	B	B	B	B
42	72	A	A	B	B	B	B	B
48	36	A	A	A	A	B	B	B
48	48	A	A	B	B	B	B	B
48	54	A	B	B	B	B	B	B
48	60	A	B	B	B	B	B	B
48	66	A	B	B	B	B	B	B
48	72	B	B	B	B	B	B	B
54	28	A	A	A	B	B	B	B
54	30	A	A	A	B	B	B	B
54	36	A	A	B	B	B	B	B
54	48	B	B	B	B	B	B	B
54	54	B	B	B	B	B	B	B
54	60	B	B	B	B	B	B	C
54	66	B	B	B	B	B	C	D
54	72	B	B	B	B	C	D	D
60	18	A	A	A	A	B	B	B
60	24	A	A	B	B	B	B	B
60	28	A	B	B	B	B	B	B
60	30	A	B	B	B	B	B	B
60	36	B	B	B	B	B	B	B
60	48	B	B	B	B	B	C	D
60	54	B	B	B	B	C	D	D
60	60	B	B	B	C	D	D	D
60	66	B	B	B	D	D	D	D
60	72	B	B	C	D	D	D	D
72	18	A	B	B	B	B	B	B
72	24	B	B	B	B	B	B	B
72	28	B	B	B	B	B	C	D
72	30	B	B	B	B	B	D	D
72	36	B	B	B	C	D	D	D
72	48	B	B	D	D	D	E	F
72	54	B	D	D	D	E	F	F
72	60	B	D	D	D	F	F	G
72	66	D	D	D	F	F	G	G
72	72	D	D	E	F	G	G	G
78	18	B	B	B	B	B	B	B
78	24	B	B	B	B	C	D	D
78	28	B	B	B	C	D	D	D
78	30	B	B	B	D	D	D	D
78	36	B	B	D	D	D	D	F
78	48	C	D	D	D	F	F	G
78	54	D	D	D	F	F	G	G
78	60	D	D	F	F	G	G	H
78	66	D	D	F	G	G	H	I
78	72	D	F	F	G	G	I	I
84	18	B	B	B	B	B	C	D
84	24	B	B	B	D	D	D	D
84	28	B	B	D	D	D	D	F
84	30	B	B	D	D	D	E	F
84	36	B	D	D	D	F	F	G
84	48	D	D	F	F	G	G	H
84	54	D	E	F	G	G	H	I
84	60	D	F	G	G	H	I	I
84	66	D	F	G	G	I	I	I
84	72	F	G	G	I	I	I	J

Continued on next page

3" Special Shape 3" Windows Frame | 3 1/4" Special Shape 3 1/4" Casement | 3 1/4" Special Shape 3 1/4" Direct Set

A - Standard Joining Mullion



B - 1/2" Structural Mullion

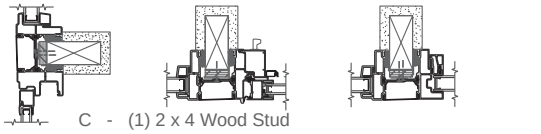

C - (1) 2 x 4 Wood Stud

D - 1" Structural Mullion



E - (2) 2 x 4 Wood Studs



F - 1/2" Structural Mullion w/1 Reinforcement



G - 1" Structural Mullion w/1 Reinforcement

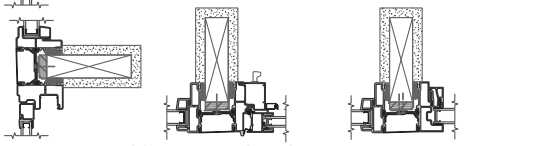

H - (1) 2 X 6 Wood Stud



I - 1" Structural Mullion w/2 Reinforcements

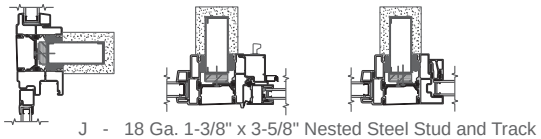

J - 18 Ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track

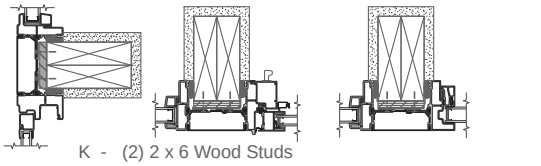

K - (2) 2 x 6 Wood Studs

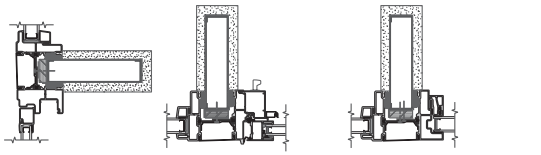

L - 20 Ga. 1-3/8" x 6" Nested Steel Stud and Track

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Two-Way Mullion Rectangle Window to Special Shape

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
90	18	B	B	B	C	D	D	D
90	24	B	B	D	D	D	D	F
90	28	B	D	D	D	E	F	F
90	30	B	D	D	D	F	F	G
90	36	D	D	D	F	G	G	G
90	48	D	F	G	G	H	I	I
90	54	D	F	G	G	I	I	I
90	60	F	G	G	I	I	I	J
90	66	F	G	H	I	I	J	K
90	72	G	G	I	I	J	K	K
96	18	B	B	C	D	D	D	D
96	24	B	D	D	D	F	F	G
96	28	D	D	D	F	F	G	G
96	30	D	D	D	F	G	G	G
96	36	D	D	F	G	G	H	I
96	48	F	G	G	I	I	I	J
96	54	F	G	H	I	I	J	K
96	60	G	G	I	I	J	K	K
96	66	G	H	I	J	K	K	L
96	72	G	I	I	J	K	L	L
108	18	C	D	D	D	F	F	G
108	24	D	D	F	G	G	G	I
108	28	D	F	G	G	H	I	I
108	30	D	F	G	G	I	I	I
108	36	F	G	G	I	I	J	J
108	48	G	I	I	J	K	K	L
108	54	G	I	J	K	K	L	L
108	60	I	I	J	K	L	L	L
108	66	I	J	K	L	L	L	L
108	72	I	J	K	L	L	L	L

3" Special Shape 3" Windows Frame | 3 1/4" Special Shape 3 1/4" Casement | 3 1/4" Special Shape 3 1/4" Direct Set



A - Standard Joining Mullion



B - 1/2" Structural Mullion

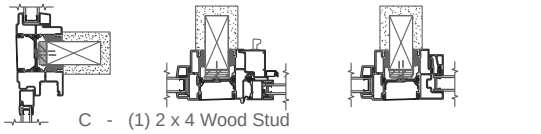

C - (1) 2 x 4 Wood Stud

D - 1" Structural Mullion



E - (2) 2 x 4 Wood Studs



F - 1/2" Structural Mullion w/1 Reinforcement



G - 1" Structural Mullion w/1 Reinforcement

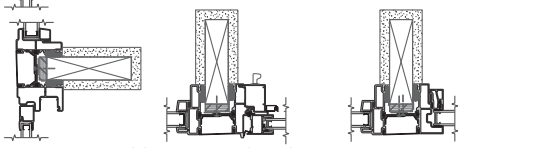

H - (1) 2 X 6 Wood Stud

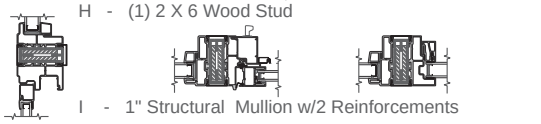

I - 1" Structural Mullion w/2 Reinforcements

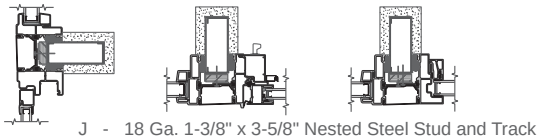

J - 18 Ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track

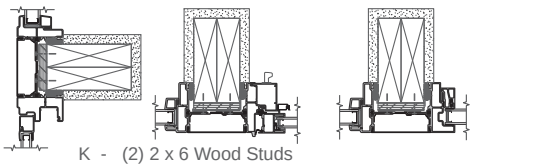

K - (2) 2 x 6 Wood Studs

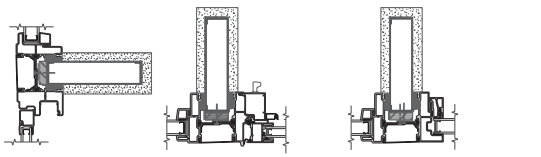

L - 20 Ga. 1-3/8" x 6" Nested Steel Stud and Track

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Three-Way Mullion of 2 Rectangle Windows to a Special Shape Window

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
42	60	B	B	B	B	B	B	B
42	66	B	B	B	B	B	B	B
42	72	B	B	B	B	B	B	B
48	36	B	B	B	B	B	B	B
48	48	B	B	B	B	B	B	B
48	54	B	B	B	B	B	B	B
48	60	B	B	B	B	B	B	C
48	66	B	B	B	B	B	C	D
48	72	B	B	B	B	C	D	D
54	28	B	B	B	B	B	B	B
54	30	B	B	B	B	B	B	B
54	36	B	B	B	B	B	B	B
54	48	B	B	B	B	B	C	D
54	54	B	B	B	B	C	D	D
54	60	B	B	B	C	D	D	D
54	66	B	B	B	D	D	D	D
54	72	B	B	C	D	D	D	D
60	18	B	B	B	B	B	B	B
60	24	B	B	B	B	B	B	B
60	28	B	B	B	B	B	B	B
60	30	B	B	B	B	B	B	C
60	36	B	B	B	B	B	C	D
60	48	B	B	B	D	D	D	D
60	54	B	B	C	D	D	D	D
60	60	B	C	D	D	D	D	D
60	66	B	D	D	D	D	D	F
60	72	B	D	D	D	D	F	F
72	18	B	B	B	B	B	B	C
72	24	B	B	B	B	D	D	D
72	28	B	B	B	D	D	D	D
72	30	B	B	C	D	D	D	D
72	36	B	C	D	D	D	D	E
72	48	D	D	D	D	F	F	F
72	54	D	D	D	F	F	F	G
72	60	D	D	E	F	F	G	G
72	66	D	D	F	F	G	G	G
72	72	D	E	F	G	G	G	I
78	18	B	B	B	B	C	D	D
78	24	B	B	C	D	D	D	D
78	28	B	C	D	D	D	D	E
78	30	B	D	D	D	D	D	F
78	36	C	D	D	D	E	F	F
78	48	D	D	E	F	F	G	G
78	54	D	D	F	F	G	G	H
78	60	D	F	F	G	G	H	I
78	66	D	F	G	G	G	I	I
78	72	E	F	G	G	I	I	I
84	18	B	B	C	D	D	D	D
84	24	B	D	D	D	D	D	F
84	28	C	D	D	D	D	F	F
84	30	D	D	D	D	F	F	F
84	36	D	D	D	F	F	G	G
84	48	D	F	F	G	G	H	I
84	54	D	F	G	G	H	I	I
84	60	F	F	G	G	I	I	I
84	66	F	G	G	I	I	I	J
84	72	F	G	H	I	I	J	J

Continued on next page

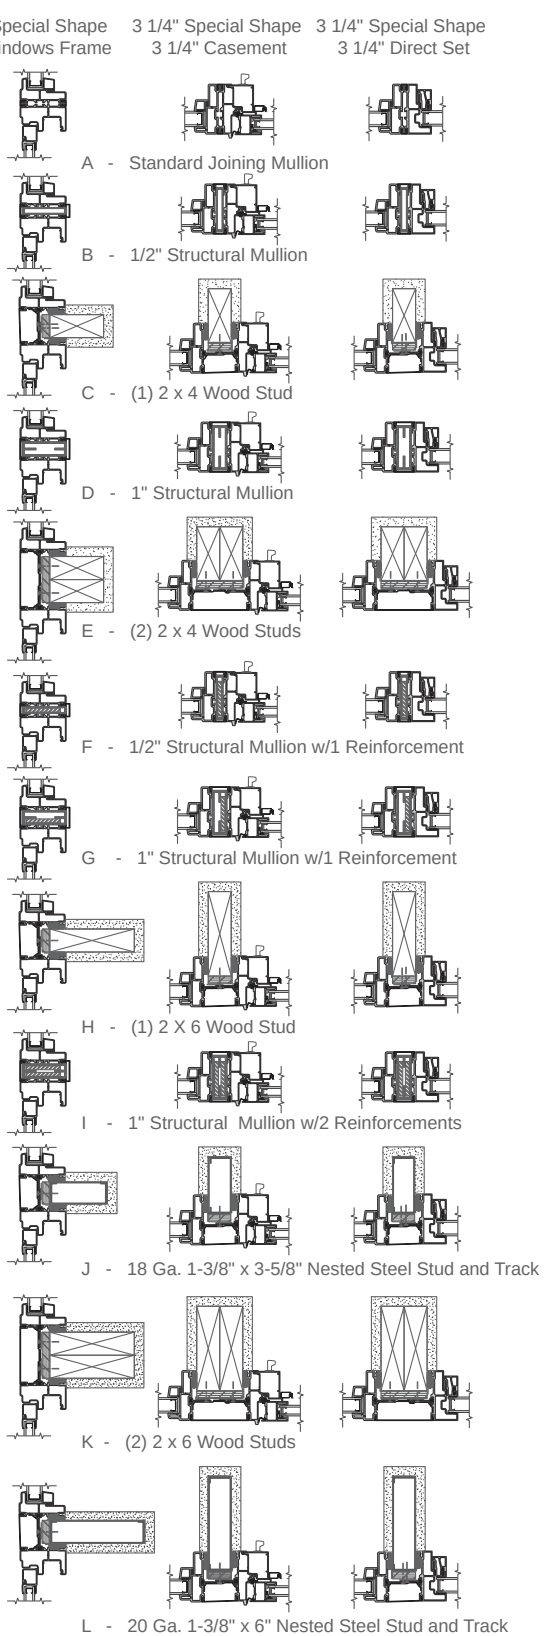

(—) = Not Applicable

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Three-Way Mullion of 2 Rectangle Windows to a Special Shape Window

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
90	18	B	C	D	D	D	D	D
90	24	C	D	D	D	F	F	F
90	28	D	D	D	F	F	G	G
90	30	D	D	D	F	F	G	G
90	36	D	D	F	G	G	G	H
90	48	F	F	G	G	I	I	I
90	54	F	G	G	I	I	I	J
90	60	F	G	H	I	I	J	J
90	66	G	G	I	I	J	J	K
90	72	G	H	I	I	J	K	K
96	18	C	D	D	D	D	F	F
96	24	D	D	D	F	F	G	G
96	28	D	D	F	F	G	G	G
96	30	D	D	F	G	G	G	H
96	36	D	F	G	G	H	I	I
96	48	F	G	H	I	I	J	J
96	54	G	G	I	I	J	J	K
96	60	G	H	I	I	J	K	L
96	66	G	I	I	J	K	K	L
96	72	H	I	J	K	K	L	L
108	18	D	D	E	F	F	G	G
108	24	D	F	F	G	G	I	I
108	28	F	F	G	G	I	I	I
108	30	F	G	G	H	I	I	J
108	36	F	G	I	I	I	J	K
108	48	G	I	I	J	K	L	L
108	54	I	I	J	K	L	L	L
108	60	I	J	K	L	L	L	L
108	66	I	J	K	L	L	L	L
108	72	I	K	L	L	L	L	L

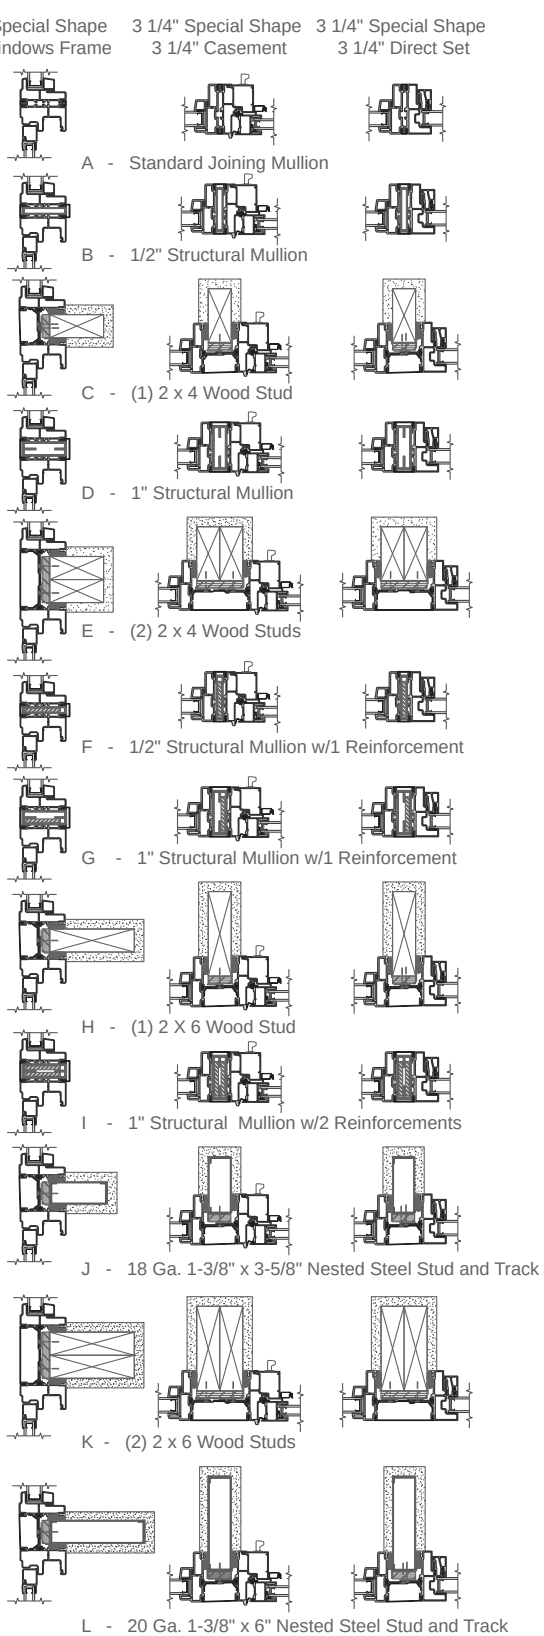

(—) = Not Applicable

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Two-Way Mullion, Vertical Door to Door

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
71.5	71.250	A	A	A	A	A	A	A
71.5	79.875	A	A	A	A	A	A	B
71.5	83.250	A	A	A	A	A	A	B
71.5	95.250	A	A	A	A	A	B	B
79.5	50.625	A	A	A	A	A	A	A
79.5	59.250	A	A	A	A	A	A	B
79.5	71.250	A	A	A	A	A	B	C
79.5	79.875	A	A	A	A	B	C	C
79.5	83.250	A	A	A	B	B	C	C
79.5	95.250	A	A	B	B	C	D	D
81.5	50.625	A	A	A	A	A	A	A
81.5	59.250	A	A	A	A	A	B	B
81.5	71.250	A	A	A	A	B	B	C
81.5	79.875	A	A	A	B	B	C	D
81.5	83.250	A	A	A	B	C	C	D
81.5	95.250	A	A	B	C	C	D	D
95.5	32.625	A	A	A	A	A	A	A
95.5	38.625	A	A	A	A	A	B	B
95.5	44.625	A	A	A	A	B	B	C
95.5	50.625	A	A	A	B	B	C	D
95.5	59.250	A	A	B	C	C	D	D
95.5	71.250	A	B	C	D	D	F	F
95.5	79.875	A	B	C	D	F	F	G
95.5	83.250	B	C	D	D	F	F	H
95.5	95.250	B	C	D	F	F	H	J
107.5	27.000	A	A	A	A	A	B	B
107.5	32.625	A	A	A	A	B	C	C
107.5	38.625	A	A	B	B	C	D	D
107.5	44.625	A	A	B	C	D	D	E
107.5	50.625	A	B	C	D	D	F	F
107.5	59.250	B	C	D	D	F	F	H
107.5	71.250	B	D	D	F	G	I	J
107.5	79.875	C	D	F	G	I	J	K
107.5	83.250	C	D	F	H	J	K	L
107.5	95.250	D	F	G	J	K	L	L
119.5	27.000	A	A	A	B	C	C	D
119.5	32.625	A	A	B	C	D	D	F
119.5	38.625	A	B	C	D	D	F	F
119.5	44.625	B	C	D	D	F	G	H
119.5	50.625	B	D	D	F	G	H	J
119.5	59.250	C	D	F	G	I	K	K
119.5	71.250	D	F	H	J	K	L	L
119.5	79.875	D	G	J	K	L	L	L
119.5	83.250	F	G	J	K	L	L	—
119.5	95.250	F	I	K	L	L	—	—





A - Standard Joining Mullion



H - 1" Structural Door Mullion



B - (1) 2 x 4 Wood Stud



I - (2) 2 x 6 Wood Studs



C - (2)-2 x 4 Wood Studs



J - 1" Structural Door Mullion w/ 1 Reinforcement



D - (1) 2 X 6 Wood Stud



K - 1" Structural Door Mullion w/ 2 Reinforcements



E - 1/2" Structural Door Mullion



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track



F - 1/2" Structural Door Mullion w/ 1 Reinforcement



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Two-Way Mullion, Horizontal Door to Rectangle Transom

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
59.25	83.75	A	A	A	A	A	A	A
59.25	89.75	A	A	A	A	A	A	B
59.25	95.75	A	A	A	A	A	A	B
59.25	101.75	A	A	A	A	A	B	B
59.25	107.75	A	A	A	A	A	B	B
71.25	46.75	A	A	A	A	A	A	A
71.25	53.75	A	A	A	A	A	A	B
71.25	59.75	A	A	A	A	A	B	B
71.25	65.75	A	A	A	A	B	B	B
71.25	71.75	A	A	A	A	B	B	C
71.25	77.75	A	A	A	B	B	C	C
71.25	83.75	A	A	A	B	B	C	C
71.25	89.75	A	A	B	B	C	C	D
71.25	95.75	A	A	B	B	C	C	D
71.25	101.75	A	B	B	C	C	D	D
71.25	107.75	A	B	B	C	C	D	D
79.875	46.75	A	A	A	A	B	B	B
79.875	53.75	A	A	A	B	B	B	C
79.875	59.75	A	A	A	B	B	C	C
79.875	65.75	A	A	B	B	C	C	D
79.875	71.75	A	A	B	C	C	D	D
79.875	77.75	A	B	B	C	C	D	D
79.875	83.75	A	B	C	C	D	D	D
79.875	89.75	A	B	C	D	D	D	F
79.875	95.75	B	B	C	D	D	D	F
79.875	101.75	B	C	C	D	D	F	F
79.875	107.75	B	C	D	D	D	F	F
83.25	46.75	A	A	A	B	B	B	C
83.25	53.75	A	A	B	B	B	C	C
83.25	59.75	A	A	B	B	C	C	D
83.25	65.75	A	B	B	C	C	D	D
83.25	71.75	A	B	B	C	D	D	D
83.25	77.75	A	B	C	C	D	D	E
83.25	83.75	B	B	C	D	D	D	F
83.25	89.75	B	C	C	D	D	F	F
83.25	95.75	B	C	D	D	D	F	F
83.25	101.75	B	C	D	D	F	F	G
83.25	107.75	B	C	D	D	F	F	H

Continued on next page

3 1/4" Direct Set
5" Door



A - Standard Joining Mullion



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track



B - (1) 2 x 4 Wood Stud



H - 1" Structural Door Mullion



C - (2)-2 x 4 Wood Studs



I - (2) 2 x 6 Wood Studs



D - (1) 2 X 6 Wood Stud

J - 1" Structural Door Mullion w/ 1 Reinforcement

E - 1/2" Structural Door Mullion



K - 1" Structural Door Mullion w/ 2 Reinforcements

F - 1/2" Structural Door Mullion w/ 1 Reinforcement



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Two-Way Mullion, Horizontal Door to Rectangle Transom

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
95.5	46.75	A	B	B	C	D	D	D
95.5	53.75	B	B	C	D	D	D	F
95.5	59.75	B	C	C	D	D	F	F
95.5	65.75	B	C	D	D	F	F	G
95.5	71.75	B	C	D	D	F	F	H
95.5	77.75	C	D	D	F	F	G	H
95.5	83.75	C	D	D	F	G	H	J
95.5	89.75	C	D	F	F	H	I	J
95.5	95.75	D	D	F	G	H	J	K
95.5	101.75	D	D	F	H	I	J	K
95.5	107.75	D	F	F	H	J	K	L
107.5	46.75	B	C	D	D	F	F	G
107.5	53.75	C	D	D	F	F	G	H
107.5	59.75	C	D	D	F	G	H	J
107.5	65.75	D	D	F	G	H	J	K
107.5	71.75	D	D	F	H	J	J	K
107.5	77.75	D	F	G	H	J	K	L
107.5	83.75	D	F	H	J	K	L	L
107.5	89.75	D	F	H	J	K	L	L
107.5	95.75	F	G	J	K	L	L	L
107.5	101.75	F	H	J	K	L	L	L
107.5	107.75	F	H	J	L	L	L	—
119.5	46.75	C	D	F	F	H	J	J
119.5	53.75	D	F	F	H	J	K	K
119.5	59.75	D	F	H	J	K	K	L
119.5	65.75	E	F	H	J	K	L	L
119.5	71.75	F	H	J	K	L	L	L
119.5	77.75	F	H	J	L	L	L	—
119.5	83.75	G	J	K	L	L	—	—
119.5	89.75	H	J	K	L	L	—	—
119.5	95.75	H	K	L	L	—	—	—
119.5	101.75	I	K	L	L	—	—	—
119.5	107.75	J	K	L	—	—	—	—

3 1/4" Direct Set
5" Door



A - Standard Joining Mullion



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track



B - (1) 2 x 4 Wood Stud



H - 1" Structural Door Mullion



C - (2)-2 x 4 Wood Studs



I - (2) 2 x 6 Wood Studs



D - (1) 2 X 6 Wood Stud

J - 1" Structural Door Mullion w/ 1 Reinforcement

E - 1/2" Structural Door Mullion



K - 1" Structural Door Mullion w/ 2 Reinforcements

F - 1/2" Structural Door Mullion w/ 1 Reinforcement



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Two-Way Mullion, Horizontal Door to Shape Transom

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
59.25	59.75	A	A	A	A	A	A	A
59.25	65.75	A	A	A	A	A	A	A
59.25	71.75	A	A	A	A	A	A	B
59.25	77.75	A	A	A	A	A	A	B
59.25	83.75	A	A	A	A	A	B	B
59.25	89.75	A	A	A	A	B	B	B
59.25	95.75	A	A	A	A	B	B	B
59.25	101.75	A	A	A	B	B	B	B
59.25	107.50	A	A	A	B	B	B	C
71.25	46.75	A	A	A	A	A	B	B
71.25	53.75	A	A	A	A	B	B	B
71.25	59.75	A	A	A	B	B	B	C
71.25	65.75	A	A	A	B	B	C	C
71.25	71.75	A	A	B	B	B	C	C
71.25	77.75	A	A	B	B	C	C	C
71.25	83.75	A	B	B	B	C	C	D
71.25	89.75	A	B	B	C	C	D	D
71.25	95.75	A	B	B	C	C	D	D
71.25	101.75	B	B	C	C	D	D	D
71.25	107.50	B	B	C	C	D	D	D
79.875	46.75	A	A	A	B	B	C	C
79.875	53.75	A	A	B	B	C	C	C
79.875	59.75	A	B	B	B	C	C	D
79.875	65.75	A	B	B	C	C	D	D
79.875	71.75	A	B	C	C	D	D	D
79.875	77.75	B	B	C	C	D	D	D
79.875	83.75	B	B	C	D	D	D	F
79.875	89.75	B	C	C	D	D	E	F
79.875	95.75	B	C	D	D	D	F	F
79.875	101.75	B	C	D	D	E	F	F
79.875	107.50	C	C	D	D	F	F	G
83.25	46.75	A	A	B	B	C	C	C
83.25	53.75	A	B	B	C	C	C	D
83.25	59.75	A	B	B	C	C	D	D
83.25	65.75	B	B	C	C	D	D	D
83.25	71.75	B	B	C	D	D	D	E
83.25	77.75	B	C	C	D	D	D	F
83.25	83.75	B	C	D	D	D	F	F
83.25	89.75	B	C	D	D	E	F	F
83.25	95.75	C	C	D	D	F	F	G
83.25	101.75	C	D	D	E	F	F	H
83.25	107.50	C	D	D	F	F	G	H
95.25	46.75	B	B	C	D	D	D	D
95.25	53.75	B	C	C	D	D	F	F
95.25	59.75	B	C	D	D	E	F	F
95.25	65.75	C	D	D	D	F	F	G
95.25	71.75	C	D	D	F	F	G	H
95.25	77.75	C	D	D	F	G	H	I
95.25	83.75	D	D	F	F	H	I	J
95.25	89.75	D	D	F	G	H	J	K
95.25	95.75	D	E	F	H	I	J	K
95.25	101.75	D	F	F	H	J	K	K
95.25	107.50	D	F	G	I	J	K	L

3 1/4" Special Shape
5" Door

A - Standard Joining Mullion



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track

B - (1) 2 x 4 Wood Stud

H - 1" Structural Door Mullion



C - (2)-2 x 4 Wood Studs



I - (2) 2 x 6 Wood Studs



D - (1) 2 X 6 Wood Stud

J - 1" Structural Door Mullion w/ 1 Reinforcement

E - 1/2" Structural Door Mullion

K - 1" Structural Door Mullion w/ 2 Reinforcements

F - 1/2" Structural Door Mullion w/ 1 Reinforcement



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Three-Way Mullion, Door to Two Transoms Horizontal Structure

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
59.25	65.75	A	A	A	A	A	A	A
59.25	71.75	A	A	A	A	A	A	B
59.25	77.75	A	A	A	A	A	B	B
59.25	83.75	A	A	A	A	A	B	B
59.25	89.75	A	A	A	A	B	B	B
59.25	95.75	A	A	A	A	B	B	B
59.25	101.75	A	A	A	B	B	B	C
59.25	107.75	A	A	A	B	B	B	C
71.25	46.75	A	A	A	A	A	B	B
71.25	53.75	A	A	A	A	B	B	B
71.25	59.75	A	A	A	B	B	B	C
71.25	65.75	A	A	A	B	B	C	C
71.25	71.75	A	A	B	B	B	C	C
71.25	77.75	A	A	B	B	C	C	D
71.25	83.75	A	B	B	C	C	C	D
71.25	89.75	A	B	B	C	C	D	D
71.25	95.75	A	B	B	C	C	D	D
71.25	101.75	B	B	C	C	D	D	D
71.25	107.75	B	B	C	C	D	D	D
79.875	46.75	A	A	A	B	B	C	C
79.875	53.75	A	A	B	B	C	C	C
79.875	59.75	A	B	B	C	C	C	D
79.875	65.75	A	B	B	C	C	D	D
79.875	71.75	B	B	C	C	D	D	D
79.875	77.75	B	B	C	C	D	D	D
79.875	83.75	B	C	C	D	D	D	F
79.875	89.75	B	C	C	D	D	E	F
79.875	95.75	B	C	D	D	D	F	F
79.875	101.75	B	C	D	D	F	F	F
79.875	107.75	C	C	D	D	F	F	G
83.25	46.75	A	A	B	B	C	C	C
83.25	53.75	A	B	B	C	C	D	D
83.25	59.75	A	B	B	C	C	D	D
83.25	65.75	B	B	C	C	D	D	D
83.25	71.75	B	B	C	D	D	D	F
83.25	77.75	B	C	C	D	D	D	F
83.25	83.75	B	C	D	D	D	F	F
83.25	89.75	B	C	D	D	F	F	F
83.25	95.75	C	C	D	D	F	F	G
83.25	101.75	C	D	D	E	F	F	H
83.25	107.75	C	D	D	F	F	G	H

Continued on next page

3 1/4" Direct Set
5" Door

A - Standard Joining Mullion



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track

3 1/4" Direct Set
5" Door



B - (1) 2 x 4 Wood Stud



H - 1" Structural Door Mullion



B - (1) 2 x 4 Wood Stud



H - 1" Structural Door Mullion



C - (2)-2 x 4 Wood Studs



I - (2) 2 x 6 Wood Studs



C - (2)-2 x 4 Wood Studs



I - (2) 2 x 6 Wood Studs



D - (1) 2 X 6 Wood Stud

J - 1" Structural Door Mullion w/ 1 Reinforcement



D - (1) 2 X 6 Wood Stud

J - 1" Structural Door Mullion w/ 1 Reinforcement

E - 1/2" Structural Door Mullion

K - 1" Structural Door Mullion w/ 2 Reinforcements

E - 1/2" Structural Door Mullion

K - 1" Structural Door Mullion w/ 2 Reinforcements

F - 1/2" Structural Door Mullion w/ 1 Reinforcement



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track

F - 1/2" Structural Door Mullion w/ 1 Reinforcement



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Three-Way Mullion, Door to Two Transoms Horizontal Structure

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
95.5	46.75	B	B	C	D	D	D	E
95.5	53.75	B	C	D	D	D	F	F
95.5	59.75	B	C	D	D	F	F	F
95.5	65.75	C	D	D	D	F	F	H
95.5	71.75	C	D	D	F	F	G	H
95.5	77.75	C	D	D	F	G	H	J
95.5	83.75	D	D	F	F	H	I	J
95.5	89.75	D	D	F	G	H	J	K
95.5	95.75	D	F	F	H	I	J	K
95.5	101.75	D	F	G	H	J	K	L
95.5	107.75	D	F	G	I	J	K	L
107.5	46.75	C	D	D	E	F	F	H
107.5	53.75	C	D	D	F	G	H	I
107.5	59.75	D	D	F	F	H	I	J
107.5	65.75	D	E	F	H	I	J	K
107.5	71.75	D	F	G	H	J	K	L
107.5	77.75	D	F	H	J	K	K	L
107.5	83.75	F	F	H	J	K	L	L
107.5	89.75	F	G	I	K	L	L	L
107.5	95.75	F	H	J	K	L	L	L
107.5	101.75	F	H	J	L	L	L	—
107.5	107.75	G	J	K	L	L	L	—
119.5	46.75	D	D	F	G	H	J	K
119.5	53.75	D	F	G	H	J	K	L
119.5	59.75	E	F	H	J	K	L	L
119.5	65.75	F	G	J	K	L	L	L
119.5	71.75	F	H	J	K	L	L	L
119.5	77.75	F	I	K	L	L	L	—
119.5	83.75	H	J	K	L	L	—	—
119.5	89.75	H	K	L	L	L	—	—
119.5	95.75	I	K	L	L	—	—	—
119.5	101.75	J	K	L	L	—	—	—
119.5	107.75	J	L	L	—	—	—	—

3 1/4" Direct Set
5" Door



B - (1) 2 x 4 Wood Stud



H - 1" Structural Door Mullion



C - (2)-2 x 4 Wood Studs



I - (2) 2 x 6 Wood Studs



D - (1) 2 X 6 Wood Stud

J - 1" Structural Door Mullion w/ 1 Reinforcement

E - 1/2" Structural Door Mullion

K - 1" Structural Door Mullion w/ 2 Reinforcements

F - 1/2" Structural Door Mullion w/ 1 Reinforcement



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track

3 1/4" Special Shape
5" Door



B - (1) 2 x 4 Wood Stud

H - 1" Structural Door Mullion



C - (2)-2 x 4 Wood Studs



I - (2) 2 x 6 Wood Studs



D - (1) 2 X 6 Wood Stud

J - 1" Structural Door Mullion w/ 1 Reinforcement

E - 1/2" Structural Door Mullion

K - 1" Structural Door Mullion w/ 2 Reinforcements

F - 1/2" Structural Door Mullion w/ 1 Reinforcement



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Four-Way Mullion, Two Doors to Two Transoms Horizontal Structure

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
42	60	B	B	B	B	B	C	C
42	66	B	B	B	B	C	C	C
42	72	B	B	B	C	C	C	C
48	36	B	B	B	B	B	B	B
48	48	B	B	B	B	C	C	C
48	54	B	B	B	B	C	C	C
48	60	B	B	B	C	C	C	C
48	66	B	B	C	C	C	C	C
48	72	B	B	C	C	C	C	C
54	28	B	B	B	B	B	B	B
54	30	B	B	B	B	B	B	B
54	36	B	B	B	B	B	C	C
54	48	B	B	B	C	C	C	C
54	54	B	B	C	C	C	C	C
54	60	B	B	C	C	C	C	C
54	66	B	C	C	C	C	C	D
54	72	B	C	C	C	C	D	D
60	18	B	B	B	B	B	B	B
60	24	B	B	B	B	B	B	B
60	28	B	B	B	B	B	C	C
60	30	B	B	B	B	B	C	C
60	36	B	B	B	C	C	C	C
60	48	B	B	C	C	C	C	C
60	54	B	C	C	C	C	C	D
60	60	B	C	C	C	C	D	D
60	66	C	C	C	C	D	D	E
60	72	C	C	C	D	D	E	E
72	18	B	B	B	B	B	B	C
72	24	B	B	B	B	C	C	C
72	28	B	B	B	C	C	C	C
72	30	B	B	C	C	C	C	C
72	36	B	C	C	C	C	C	D
72	48	C	C	C	C	D	E	E
72	54	C	C	C	D	E	E	E
72	60	C	C	D	E	E	E	F
72	66	C	C	D	E	E	F	F
72	72	C	D	E	E	E	F	F
78	18	B	B	B	B	C	C	C
78	24	B	B	C	C	C	C	C
78	28	B	B	C	C	C	C	C
78	30	B	C	C	C	C	C	D
78	36	C	C	C	C	D	D	E
78	48	C	C	D	D	E	E	E
78	54	C	C	D	E	E	E	F
78	60	C	D	E	E	E	F	F
78	66	C	D	E	E	F	F	F
78	72	D	E	E	F	F	F	F
84	18	B	B	B	C	C	C	C
84	24	B	C	C	C	C	C	D
84	28	B	C	C	C	C	D	D
84	30	C	C	C	C	D	D	D
84	36	C	C	C	D	D	E	E
84	48	C	D	D	E	E	F	F
84	54	C	D	E	E	F	F	F
84	60	D	D	E	E	F	F	F
84	66	D	E	E	F	F	F	G
84	72	D	E	F	F	F	F	H

Continued on next page

3 1/4" Direct Set
5" Door



B - (1) 2 x 4 Wood Stud



H - 1" Structural Door Mullion



C - (2)-2 x 4 Wood Studs



I - (2) 2 x 6 Wood Studs



D - (1) 2 X 6 Wood Stud



J - 1" Structural Door Mullion w/ 1 Reinforcement

E - 1/2" Structural Door Mullion

K - 1" Structural Door Mullion w/ 2 Reinforcements

F - 1/2" Structural Door Mullion w/ 1 Reinforcement



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track

3 1/4" Special Shape
5" Door



B - (1) 2 x 4 Wood Stud

H - 1" Structural Door Mullion



C - (2)-2 x 4 Wood Studs



I - (2) 2 x 6 Wood Studs



D - (1) 2 X 6 Wood Stud

J - 1" Structural Door Mullion w/ 1 Reinforcement

E - 1/2" Structural Door Mullion

K - 1" Structural Door Mullion w/ 2 Reinforcements

F - 1/2" Structural Door Mullion w/ 1 Reinforcement



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Four-Way Mullion, Two Doors to Two Transoms Horizontal Structure

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
90	18	B	B	C	C	C	C	C
90	24	C	C	C	C	D	D	D
90	28	C	C	C	D	D	D	E
90	30	C	C	C	D	D	E	E
90	36	C	C	D	D	E	E	E
90	48	D	D	E	E	F	F	F
90	54	D	E	E	F	F	F	G
90	60	D	E	E	F	F	G	H
90	66	D	E	F	F	F	H	H
90	72	E	E	F	F	G	H	J
96	18	B	C	C	C	C	D	D
96	24	C	C	C	D	D	D	E
96	28	C	C	D	D	D	E	E
96	30	C	C	D	D	E	E	E
96	36	C	D	D	E	E	F	F
96	48	D	E	E	F	F	F	G
96	54	D	E	F	F	F	H	H
96	60	E	E	F	F	G	H	J
96	66	E	F	F	G	H	I	J
96	72	E	F	F	H	I	J	K
108	18	C	C	D	D	D	D	D
108	24	C	D	D	D	E	F	F
108	28	D	D	D	E	F	F	F
108	30	D	D	D	E	F	F	F
108	36	D	D	F	F	F	G	H
108	48	E	F	F	G	H	J	J
108	54	F	F	G	H	J	J	K
108	60	F	F	H	J	J	K	L
108	66	F	G	H	J	K	L	L
108	72	F	H	J	K	K	L	L

3 1/4" Direct Set
5" Door



B - (1) 2 x 4 Wood Stud



H - 1" Structural Door Mullion



C - (2)-2 x 4 Wood Studs



I - (2) 2 x 6 Wood Studs



D - (1) 2 X 6 Wood Stud



J - 1" Structural Door Mullion w/ 1 Reinforcement



E - 1/2" Structural Door Mullion



K - 1" Structural Door Mullion w/ 2 Reinforcements

F - 1/2" Structural Door Mullion w/ 1 Reinforcement



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track

3 1/4" Special Shape
5" Door

B - (1) 2 x 4 Wood Stud

H - 1" Structural Door Mullion



C - (2)-2 x 4 Wood Studs



I - (2) 2 x 6 Wood Studs



D - (1) 2 X 6 Wood Stud

J - 1" Structural Door Mullion w/ 1 Reinforcement



E - 1/2" Structural Door Mullion

K - 1" Structural Door Mullion w/ 2 Reinforcements

F - 1/2" Structural Door Mullion w/ 1 Reinforcement



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Four-Way Mullion, Two Doors to Two Transoms Vertical Structure

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
42	60	B	B	B	B	B	C	C
42	66	B	B	B	B	C	C	C
42	72	B	B	B	C	C	C	C
48	36	B	B	B	B	B	B	B
48	48	B	B	B	B	C	C	C
48	54	B	B	B	B	C	C	C
48	60	B	B	B	C	C	C	C
48	66	B	B	C	C	C	C	C
48	72	B	B	C	C	C	C	C
54	28	B	B	B	B	B	B	B
54	30	B	B	B	B	B	B	B
54	36	B	B	B	B	B	C	C
54	48	B	B	B	C	C	C	C
54	54	B	B	C	C	C	C	C
54	60	B	B	C	C	C	C	C
54	66	B	C	C	C	C	C	D
54	72	B	C	C	C	C	D	D
60	18	B	B	B	B	B	B	B
60	24	B	B	B	B	B	B	B
60	28	B	B	B	B	B	C	C
60	30	B	B	B	B	B	C	C
60	36	B	B	B	C	C	C	C
60	48	B	B	C	C	C	C	C
60	54	B	C	C	C	C	C	D
60	60	B	C	C	C	C	D	D
60	66	C	C	C	C	D	D	G
60	72	C	C	C	D	D	G	G
72	18	B	B	B	B	B	B	C
72	24	B	B	B	B	C	C	C
72	28	B	B	B	C	C	C	C
72	30	B	B	C	C	C	C	C
72	36	B	C	C	C	C	C	D
72	48	C	C	C	C	D	G	G
72	54	C	C	C	D	G	G	G
72	60	C	C	D	G	G	G	G
72	66	C	C	D	G	G	G	G
72	72	C	D	G	G	G	G	G
78	18	B	B	B	B	C	C	C
78	24	B	B	C	C	C	C	C
78	28	B	B	C	C	C	C	C
78	30	B	C	C	C	C	C	D
78	36	C	C	C	C	D	D	G
78	48	C	C	D	D	G	G	G
78	54	C	C	D	G	G	G	G
78	60	C	D	G	G	G	G	G
78	66	C	D	G	G	G	G	G
78	72	D	G	G	G	G	G	L
84	18	B	B	B	C	C	C	C
84	24	B	C	C	C	C	C	D
84	28	B	C	C	C	C	D	D
84	30	C	C	C	C	D	D	D
84	36	C	C	C	D	D	G	G
84	48	C	D	D	G	G	G	G
84	54	C	D	G	G	G	G	G
84	60	D	D	G	G	G	G	I
84	66	D	G	G	G	G	G	L
84	72	D	G	G	G	G	L	L





B - (1) 2 x 4 Wood Stud



C - (2)-2 x 4 Wood Studs



D - (1) 2 X 6 Wood Stud



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track



I - (2) 2 x 6 Wood Studs



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track

Continued on next page

Note - only field structure options are shown as Pella structural mullions are not to be used as vertical through structure at four way mullions.

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.

Four-Way Mullion, Two Doors to Two Transoms Vertical Structure

Maximum Allowable Design Pressure (psf)								
L (in)	W (in)	20	25	30	35	40	45	50
90	18	B	B	C	C	C	C	C
90	24	C	C	C	C	D	D	D
90	28	C	C	C	D	D	D	G
90	30	C	C	C	D	D	G	G
90	36	C	C	D	D	G	G	G
90	48	D	D	G	G	G	G	G
90	54	D	G	G	G	G	G	L
90	60	D	G	G	G	G	L	L
90	66	D	G	G	G	I	L	L
90	72	G	G	G	G	L	L	L
96	18	B	C	C	C	C	D	D
96	24	C	C	C	D	D	D	G
96	28	C	C	D	D	D	G	G
96	30	C	C	D	D	G	G	G
96	36	C	D	D	G	G	G	G
96	48	D	G	G	G	G	G	L
96	54	D	G	G	G	G	L	L
96	60	G	G	G	G	L	L	L
96	66	G	G	G	I	L	L	L
96	72	G	G	G	L	L	L	—
108	18	C	C	D	D	D	D	D
108	24	C	D	D	D	G	G	G
108	28	D	D	D	G	G	G	G
108	30	D	D	D	G	G	G	G
108	36	D	D	G	G	G	G	I
108	48	G	G	G	G	L	L	L
108	54	G	G	G	L	L	L	L
108	60	G	G	I	L	L	L	—
108	66	G	G	L	L	L	—	—
108	72	G	I	L	L	—	—	—



Note - only field structure options are shown as Pella structural mullions are not to be used as vertical through structure at four way mullions.



B - (1) 2 x 4 Wood Stud



C - (2)-2 x 4 Wood Studs



D - (1) 2 X 6 Wood Stud



G - 18 ga. 1-3/8" x 3-5/8" Nested Steel Stud and Track



I - (2) 2 x 6 Wood Studs



L - 20 ga. 1-3/8" x 6" Nested Steel Stud and Track

- All reinforcing mullions must be properly secured at ends. Wall framing around window opening must be adequate to withstand wind loads transferred from window composite and reinforcing mullions.
- Do not use these accessories or mullions for structural vertical loading. Reinforcing mullions are for wind loading only.
- If mullion length or load factor exceed chart values, please contact your local Pella sales representative.
- Design charts are not valid for locations where impact forces from wind-borne debris must be considered.
- Chart shows mullion reinforcement requirements using engineered mullion strength values to meet L/175 ≤ .75" deflection, per instructions on page 3.